



AMC-UTx-M-400

Modbus RTU Sensor/Transmitter

USER MANUAL



3550409B

Copyright © 2025 AMC

The Armstrong Monitoring Corporation

215 Colonnade Road South, Ottawa, Ontario, Canada K2E 7K3

Tel: (613) 225 9531 • Fax: (613) 225 6965 • Canada & U.S. Toll Free: 1 (800) 465 5777

Email: support@armstrongmonitoring.com • Website: www.armstrongmonitoring.com



Table of Contents

| | | |
|-----------|--|-----------|
| 1. | General Information | 8 |
| 1.1 | Warranty | 8 |
| 1.2 | Liability | 8 |
| 1.3 | Product Return | 8 |
| 1.4 | Contact Information | 8 |
| 1.5 | Modifications and Substitutions..... | 9 |
| 1.6 | Glossary..... | 9 |
| 2. | Product Specifications..... | 10 |
| 2.1 | AMC-UTx-M-xx-0400 Transmitter Specifications | 10 |
| 2.2 | Transmitter Order Numbers | 10 |
| 2.3 | Sensor Module | 11 |
| 2.3.1 | Carbon Monoxide | 11 |
| 2.3.2 | Carbon Monoxide/Nitrogen Dioxide..... | 11 |
| 2.3.3 | Nitrogen Dioxide | 12 |
| 2.3.4 | Methane..... | 12 |
| 2.3.5 | Propane | 13 |
| 2.3.6 | Hydrogen..... | 13 |
| 2.3.7 | Oxygen | 14 |
| 2.4 | Product Description..... | 15 |
| 2.5 | External View..... | 16 |
| 2.6 | Internal View | 17 |
| 2.7 | Accessories..... | 18 |
| 2.7.1 | UTx Calibration Kit | 18 |
| 3. | Installation..... | 19 |
| 3.1 | Overview | 19 |
| 3.2 | Transmitter Mounting..... | 19 |
| 3.3 | Accessory Mounting | 22 |
| 3.3.1 | Weathershield | 22 |
| 3.3.2 | Vandal Guard..... | 23 |
| 3.3.3 | Pole Mounting Brackets..... | 24 |



| | |
|---|-----------|
| 3.4 Wiring | 25 |
| 3.4.1 Power | 27 |
| 3.4.2 Communication | 27 |
| 3.4.2.1 End of Line (EOL) Setting | 28 |
| 4. Operation | 31 |
| 4.1 Overview | 31 |
| 4.2 Status LEDs..... | 31 |
| 4.2.1 Start Up..... | 31 |
| 4.2.2 Network Status | 31 |
| 4.2.3 Faults..... | 32 |
| 4.2.4 Alarms | 33 |
| 4.2.5 Calibration | 33 |
| 4.2.6 Miscellaneous | 34 |
| 4.3 Menu Overview..... | 34 |
| 4.3.1 Normal Operation | 34 |
| 4.3.2 Failed Sensor | 35 |
| 4.3.3 Warning/Alarm Indication | 36 |
| 4.3.4 Fault Indication | 37 |
| 4.3.5 Detailed Sensor Screen | 38 |
| 4.3.6 Detailed Status Screen | 38 |
| 4.3.7 Password Entry | 39 |
| 4.3.8 Main Service Menu | 40 |
| 4.3.8.1 Service Menu Timeout..... | 40 |
| 4.3.8.2 Service Menu Overview | 40 |
| 4.3.9 Transmitter Service Menu..... | 41 |
| 4.3.9.1 Modbus Settings | 42 |
| 4.3.9.2 Transmitter Sensors Settings | 42 |
| 4.3.9.3 Sensor Alarm Configuration Sub-Menu | 43 |
| 4.3.9.4 Transmitter Alarms Settings | 45 |
| 4.3.9.5 Alarm Sub-Menu | 46 |
| 4.3.9.6 Transmitter Relay Settings | 50 |



| | | |
|-----------|---|-----------|
| 4.3.9.7 | RTC Date & Time | 51 |
| 4.3.10 | Calibration | 52 |
| 4.3.10.1 | Required Equipment; EZ Cal Exchange Program | 53 |
| 4.3.10.2 | Required Equipment; On-Site Sensor Module Calibration | 53 |
| 4.3.10.3 | Pre Bump Test | 53 |
| 4.3.10.4 | Calibration Procedure – Menu | 54 |
| 4.3.10.5 | Calibration Procedure – Routine | 56 |
| 5. | Maintenance | 58 |
| 5.1 | General | 58 |
| 5.2 | Scheduled Calibration | 58 |
| 5.3 | Sensor Module | 58 |
| 5.3.1 | Sensor Module Replacement | 58 |
| 5.3.1.1 | Remove Sensor Module | 59 |
| 5.3.1.2 | Install Sensor Module | 60 |
| 5.4 | Verification of Operation | 61 |
| 5.4.1 | Simulation of Gas Levels | 61 |
| 5.4.2 | LED/Relay Activation Test | 62 |
| 6. | Modbus | 63 |
| 6.1 | Register Set | 63 |
| 7. | Troubleshooting | 66 |
| 7.1 | Symptoms and Corrective Actions | 66 |
| 8. | Sensor Module Default Settings | 69 |
| 8.1 | Default Alarm Settings | 69 |
| 8.2 | Default Sensor Module Settings | 70 |
| 9. | Menu Flow Diagrams | 71 |
| 9.1 | Main Screen / Password Flow | 71 |
| 9.2 | UTx Service Menu | 72 |
| 9.3 | Modbus Menu | 74 |
| 9.4 | Sensor Service Menu | 75 |
| 9.5 | Sensor Configuration Menu | 77 |
| 9.6 | Alarm Menu | 78 |



10. Revision History 79
10.1 Document Revision History.....79



List of Figures

| | |
|--|----|
| Figure 3-1: Example of Connections to AMC-1DB1-3XXX Digital Monitor..... | 26 |
| Figure 3-2: Disconnecting BusPower Module | 28 |
| Figure 3-3: Removing BusPower Module | 29 |
| Figure 3-4: EOL Switch | 29 |
| Figure 3-5: Replacing BusPower Module | 30 |
| Figure 5-1: Disconnect Sensor Module..... | 59 |
| Figure 5-2: Removing Sensor Module from Lid..... | 59 |
| Figure 5-3: Installing Sensor Module | 60 |
| Figure 5-4: Attaching Cable to Sensor Module | 60 |
| Figure 9-1: Main Screen / Password Flow Diagram | 71 |
| Figure 9-2: UTx Service Menu Flow Diagram (a) | 72 |
| Figure 9-3: UTx Service Menu Flow Diagram (b) | 73 |
| Figure 9-4: Modbus Menu Flow Diagram | 74 |
| Figure 9-5: Sensor Service Menu Flow Diagram (a) | 75 |
| Figure 9-6: Sensor Service Menu Flow Diagram (b) | 76 |
| Figure 9-7: Sensor Configuration Menu Flow Diagram..... | 77 |
| Figure 9-8: Alarm Menu Flow Diagram..... | 78 |



List of Tables

| | |
|---|----|
| Table 4-1: Status LEDs (Start Up) | 31 |
| Table 4-2: Status LEDs (Network Status) | 31 |
| Table 4-3: Status LEDs (Faults) | 32 |
| Table 4-4: Status LEDs (Alarms)..... | 33 |
| Table 4-5: Status LEDs (Calibration)..... | 33 |
| Table 4-6: Status LEDs (Miscellaneous) | 34 |
| Table 4-7: Service Menu Options..... | 40 |
| Table 4-8: Transmitter Service Menu Options | 41 |
| Table 4-9: Sensor Module Configuration Menu | 43 |
| Table 4-10: Sensor Alarm Configuration | 43 |
| Table 4-11: Calibration Frequency Configuration | 45 |
| Table 4-12: Transmitter Alarm Settings..... | 46 |
| Table 4-13: Transmitter Alarm Sub-Menu Settings | 46 |
| Table 4-14: Alarm Input Options..... | 48 |
| Table 4-15: Alarm Setpoint Options..... | 48 |
| Table 4-16: Alarm Type Options | 49 |
| Table 6-1: Modbus Registers 1 | 64 |
| Table 6-2: Modbus Registers 2 | 65 |
| Table 7-1: Troubleshooting Table..... | 66 |
| Table 8-1: Default Alarm Settings | 69 |
| Table 8-2: Default Sensor Module Settings | 70 |



1. General Information

1.1 Warranty

This product is warranted against defects in material and workmanship for a period of two years from date of delivery. Maintenance items are not warranted. During the warranty period, *The Armstrong Monitoring Corporation* will repair or replace components that prove to be defective in the opinion of AMC. Any equipment deemed to be defective by the user should be returned to *The Armstrong Monitoring Corporation* for evaluation (see product return below). Site visits by Armstrong personnel, to evaluate/repair equipment, are not covered by this warranty unless covered under the site contract. AMC is not liable for auxiliary interfaced equipment, nor for consequential damage. This warranty shall not apply to any product which has been modified in any way, which has been repaired by any other party other than a qualified technician or authorized AMC representative, or when failure is due to misuse or conditions of use.

Note: Extended Warranty and mail in calibration programs are available (please call 1-800-465-5777) or see our contacts page at www.armstrongmonitoring.com

1.2 Liability

All AMC products must be installed and maintained according to instructions. Only qualified personnel should install and maintain the equipment. This product must not be placed in areas with combustible gases reaching 100% LEL (environments prone to explosions).

AMC shall have no liability arising from auxiliary interfaced equipment, for consequential damage, or the installation and operation of this equipment. AMC shall have no liability for labor or freight costs, or any other costs or charges in excess of the amount of the invoice for the products.

THIS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED OR IMPLIED AND SPECIFICALLY THE WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THERE ARE NO WARRANTIES THAT EXTEND BEYOND THE DESCRIPTION ON THE FACE THEREOF.

1.3 Product Return

All products returned for warranty or service should be shipped by prepaid freight and will be accepted only with RMA or repair number issued by AMC.

1.4 Contact Information

For information, please call 1-800-465-5777, visit www.armstrongmonitoring.com or email directly support@armstrongmonitoring.com.



1.5 Modifications and Substitutions

Due to an ongoing development program, AMC reserves the right to substitute components and change specifications at any time without incurring any obligations.

1.6 Glossary

| | |
|-------------------|--|
| Act Delay | The delay in seconds between the gas concentration reaching an alarm setpoint, and the corresponding alarm level activating. |
| Alarm | Alarm is an audible, visual, or physical presentation designed to warn the instrument user that a specific level of a dangerous gas/vapor concentration has been reached or exceeded. |
| Calibration | Calibration is the procedure used to adjust the instrument for proper response. |
| Calibration Gas | Calibration Gas is a gas of known concentration used in adjusting and testing gas detection equipment to ensure proper function and accurate readings. |
| Gas Concentration | Gas Concentration can be measured in: <ul style="list-style-type: none">• ppm• %LEL• % Volume |
| Hysteresis | A user-set difference from an alarm's setpoint prevents frequent alarm activation. Hysteresis solely impacts alarm deactivation, not its activation tied to the setpoint. |
| LEL | Lower Explosive Limit is the lowest concentration (percentage) of a gas or a vapor in air capable of combusting in the presence of an ignition source (arc, flame, heat). |
| Min Run | The minimum time in seconds that an alarm state will remain active, even if the gas concentration has returned above/below the setpoint +/- hysteresis (based on a decreasing or increasing alarm type). |
| ppm | Parts Per Million (1% volume = 10,000ppm) |
| Percent by Volume | Concentration of gas in a mixture expressed as a percentage of total volume. |
| Span | The difference between the highest concentration and lowest concentration. |
| T90 | Response Time in seconds to achieve 90% gas concentration reading. |
| T99 | Response Time in seconds to achieve 99% gas concentration reading. |
| Zero Buffering | Zero buffering is a function of the monitor which forces the gas concentration reading to zero when sensor is exposed to low concentration of a gas. The zero buffer is indicated in the sensor specification. |
| Zero Gas | Zero gas is gas in which the target gas is not present. The presence of oxygen is required. Clean air is an excellent source for zero calibration. A known gas concentration can be entered during zero calibration. |



2. Product Specifications

2.1 AMC-UTx-M-xx-0400 Transmitter Specifications

| System | |
|--------------------------|--|
| System Warranty Period | 2 Years |
| Power Supply Requirement | 24VDC, 40mA |
| Relays | SPDT, 30VDC, 2A (resistive) |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Operating Pressure | 0.9 to 1.1 atm |
| Humidity Range | 15 to 90% RH, non-condensing |
| Signaling | Modbus RTU 9600 Baud, 8bit, Even Parity |

2.2 Transmitter Order Numbers

| Transmitter Order Number | Description |
|------------------------------|---|
| AMC-UTx-M-91A01-98A01-R-0400 | UTx Modbus 400, 2 Sensor Modules CO 0-100ppm, NO ₂ 0-10ppm, Relay |
| AMC-UTx-M-91B01-98A01-R-0400 | UTx Modbus 400, 2 Sensor Modules CO 0-300ppm, NO ₂ 0-10ppm, Relay |
| AMC-UTx-M-VCA01-N-R-0400 | UTx Modbus 400, 1 Dual Sensor Module CO 0-100ppm, NO ₂ 0-10ppm, Relay |
| AMC-UTx-M-VCB01-N-R-0400 | UTx Modbus 400, 1 Dual Sensor Module CO 0-300ppm, NO ₂ 0-10ppm, Relay |
| AMC-UTx-M-91A01-N-R-0400 | UTx Modbus 400, 1 Sensor Module CO 0-100ppm, Relay |
| AMC-UTx-M-91B01-N-R-0400 | UTx Modbus 400, 1 Sensor Module CO 0-300ppm, Relay |
| AMC-UTx-M-98A01-N-R-0400 | UTx Modbus 400, 1 Sensor Module NO ₂ 0-10ppm, Relay |
| AMC-UTx-M-60A01-N-R-0400 | UTx Modbus 400, 1 Sensor Module CH ₄ 0-100% LEL, Relay |
| AMC-UTx-M-61A01-N-R-0400 | UTx Modbus 400, 1 Sensor Module C ₃ H ₈ 0-100% LEL, Relay |
| AMC-UTx-M-62A01-N-R-0400 | UTx Modbus 400, 1 Sensor Module H ₂ 0-100% LEL, Relay |
| AMC-UTx-M-70A01-N-R-0400 | UTx Modbus 400, 1 Sensor Module O ₂ 0-25% Vol, Relay |



2.3 Sensor Module

2.3.1 Carbon Monoxide

| | |
|--|--|
| Gas Type | CARBON MONOXIDE (CO) |
| Sensor Module Order Number | AMC-SM-91A01 (0-100ppm) AMC-SM-91B01 (0-300ppm) |
| Detection Range | See Above |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | 4-6 Feet (1.2 – 1.5m) |
| Sensor Life | Up to 6 Years |
| Sensor Warranty | 3 Years |
| Zero Buffering of Display | < 5ppm |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | 100ppm CO – 91A01 300ppm CO – 91B01 |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |

2.3.2 Carbon Monoxide/Nitrogen Dioxide

| | |
|--|---|
| Gas Type | CARBON MONOXIDE (CO) NITROGEN DIOXIDE (NO ₂) |
| Sensor Module Order Number | AMC-SM-VCA01 |
| Detection Range | 0-100ppm CO 0-10ppm NO ₂ |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | 4-6 Feet (1.2 – 1.5m) |
| Sensor Life | Up to 2 Years NO ₂ Up to 6 Years CO |
| Sensor Warranty | 2 Years |
| Zero Buffering of Display | < 5ppm CO < 0.5ppm NO ₂ |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | 100ppm CO 10ppm NO ₂ |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |



2.3.3 Nitrogen Dioxide

| | |
|--|-------------------------------------|
| Gas Type | NITROGEN DIOXIDE (NO ₂) |
| Sensor Module Order Number | AMC-SM-98A01 |
| Detection Range | 0-10ppm |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | 4-6 Feet (1.2 – 1.5m) |
| Sensor Life | Up to 2 Years |
| Sensor Warranty | 1 Year |
| Zero Buffering of Display | < 0.5ppm NO ₂ |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | 10ppm NO ₂ |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |

2.3.4 Methane

| | |
|--|--|
| Gas Type | METHANE (CH ₄) |
| Sensor Module Order Number | AMC-SM-60A01 |
| Detection Range | 0-100% LEL |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | Place 18 inches (20.32 cm) down from the top of the ceiling. Do not mount directly to ceiling. |
| Sensor Life | > 2 Years |
| Sensor Warranty | 1 Year |
| Zero Buffering of Display | 5% LEL |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | 50% LEL CH ₄ |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |



2.3.5 Propane

| | |
|--|---|
| Gas Type | PROPANE (C ₃ H ₈) |
| Sensor Module Order Number | AMC-SM-61A01 |
| Detection Range | 0-100% LEL |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | Place 18 inches (20.32 cm) up from the bottom of the floor. Do not mount directly to floor. |
| Sensor Life | > 2 Years |
| Sensor Warranty | 1 Year |
| Zero Buffering of Display | 5% LEL |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | 50% LEL C ₃ H ₈ |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |

2.3.6 Hydrogen

| | |
|--|--|
| Gas Type | HYDROGEN (H ₂) |
| Sensor Module Order Number | AMC-SM-62A01 |
| Detection Range | 0-100% LEL |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | Place 18 inches (20.32 cm) down from the top of the ceiling. Do not mount directly to ceiling. |
| Sensor Life | > 2 Years |
| Sensor Warranty | 1 Year |
| Zero Buffering of Display | 5% LEL |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | 50% LEL H ₂ |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |



2.3.7 Oxygen

| | |
|--|-------------------------------|
| Gas Type | OXYGEN (O ₂) |
| Sensor Module Order Number | AMC-SM-70A01 |
| Detection Range | 0-25% Vol |
| Operating Temperature | -4° to 104° F (-20° to 40° C) |
| Sensor Height Above Finished Floor (As part of Digital Transmitter) | 4-6 Feet (1.2 – 1.5m) |
| Sensor Life | Up to 2 Years |
| Sensor Warranty | 2 Years |
| Zero Buffering of Display | < 1.25% Vol |
| Calibration Kit Part Number | AMC-C1-FM2 |
| Recommended Calibration Gas | Pure Nitrogen |
| Gas Flow Rate | 0.01765 cfm (0.5L/min) |

2.4 Product Description




The AMC-UTx Digital Transmitter is designed to provide continuous, reliable monitoring of ambient air for target gas(es) via onboard sensor modules.

The transmitter provides a digital representation of the gas concentration detected; this information is both displayed locally (via OLED) and sent to the respective Monitor upstream over RS-485 using MODBUS/RTU. Plug-and-play modular architecture accommodates; hot-commissioning and field replaceable Sensor Modules (eligible for the EZ-CAL exchange program).


In addition, each transmitter features alarm/system status indicators, audible feedback, an on-board relay and colour-coded connection terminal blocks, as listed and described herein.

2.5 External View

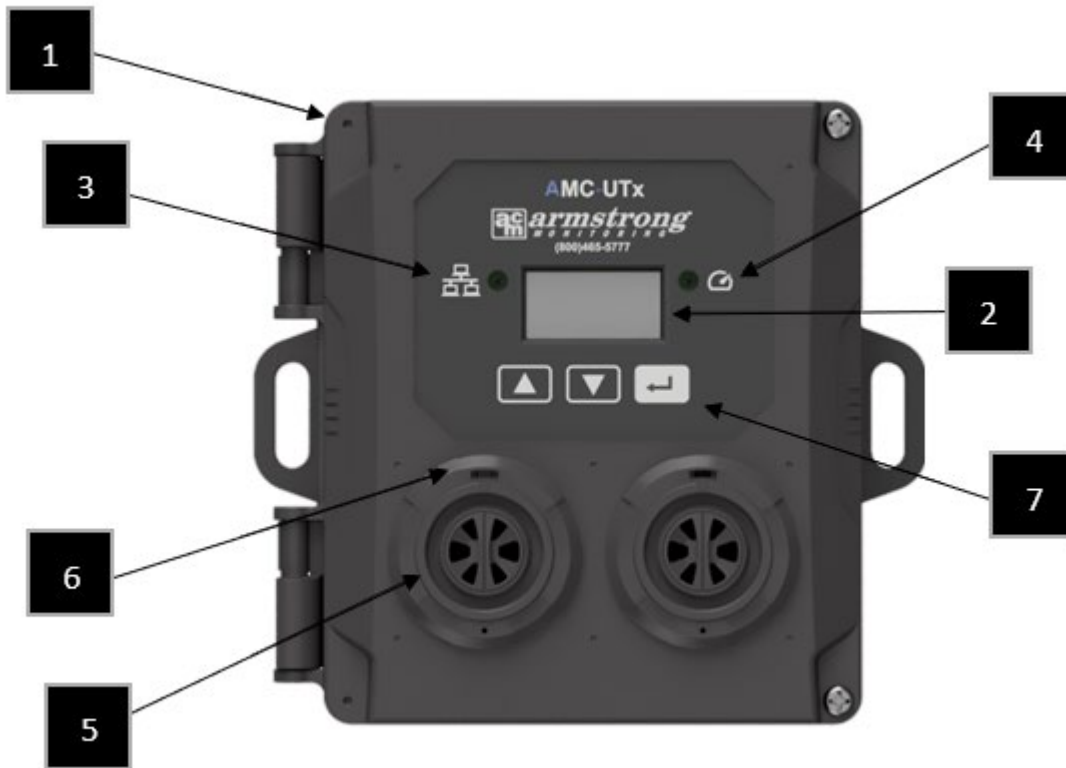

| | | |
|---|--------------------|--|
| 1 | Enclosure Lid | Enclosure and Lid Assembly, PC-ABS blend, 5.45" L x 6.14" W (140mm x 156mm) Wall Mount with two mount points. Option for Pole Mount. |
| 2 | Display | Displays Gas Concentration & Status Information. |
| 3 | Network Status LED | Indicates Status of Network Interface and will show whether or not the UTx has established / maintained Network Communication. |
| 4 | Alarm Status LED | The Sensor Status LED will show the same error code that is being communicated by the Sensor Module(s) or display the highest priority error (if multiple error codes are being communicated to it by the Sensor Module(s)). |
| 5 | Sensor Module | This inlet allows target gas to flow into the sensor. The inlet is also used for gas calibration. |
| 6 | Sensor Module LED | Sensor Module LEDs will show the status of the sensor element within the Sensor Module, or the status of the Sensor Module itself. |
| 7 | Menu Buttons | Momentary Pushbuttons for user interface. |

2.6 Internal View

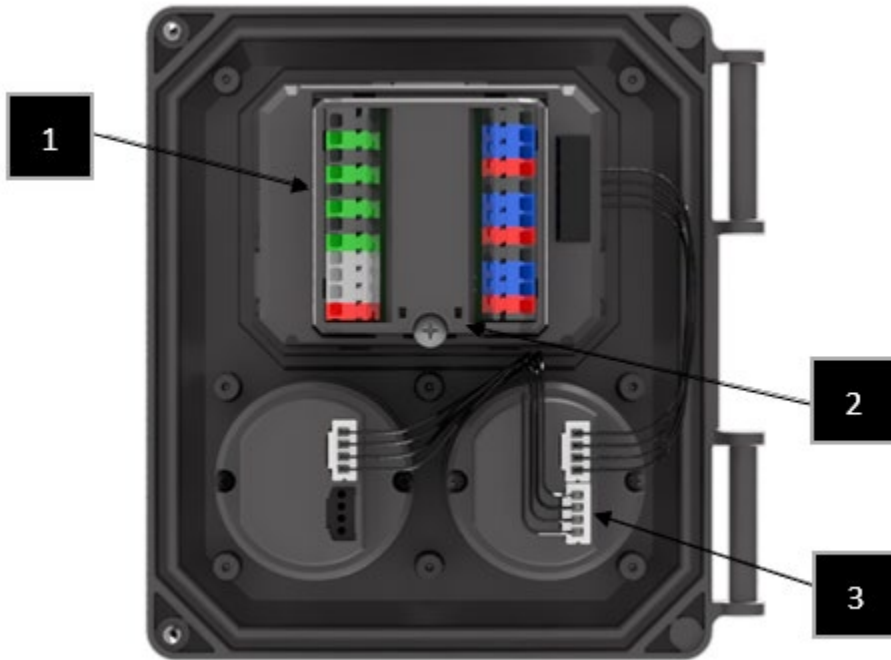

| | | |
|---|---------------------------|--|
| 1 | Bus Power Connectors | The two 12 pin connectors on the BusPower Module provide all interfaces to the UTx-M-xx-400. |
| 2 | EOL LED | This LED will be illuminated GREEN if the UTx is configured as EOL. |
| 3 | Sensor Module Connections | Connectors on the Sensor Module(s) are used to connect between Sensor Modules and between Sensor Module 1 and the Transmitter. |

2.7 Accessories

| Accessory Description | Order Code | Notes |
|------------------------------------|--------------------------------|--|
| Weathershield for AMC Transmitters | AMC-WS00-SL | Refer to Weathershield section for mounting instructions. |
| Vandal Guard Universal Fit | AMC-VG-XL | Refer to Vandal Guard section for mounting instructions. |
| Pole Mounting Brackets | Included with Each Transmitter | Refer to Pole Mounting Brackets section for mounting instructions. |
| Calibration Kit | AMC-C1-FM2 | Refer to UTx Calibration Kit section for details. |
| Calibration Adapter | AMC-FM2 | Refer to UTx Calibration Kit section for details. |

2.7.1 UTx Calibration Kit

The UTx Calibration Kit, as shown below, consists of the AMC-FM2 Calibration Adaptor that secures the calibration gas hose to the front of the UTx Sensor Module along with a hose to connect to the calibration gas cylinder regulator.





3. Installation

3.1 Overview

NOTE: All Armstrong Monitoring systems must be installed and maintained according to instructions to assure proper operation. Only qualified personnel should install and maintain the equipment. For exchange, re-calibration or extended warranty programs information please call 1-800-465-5777 or through contacts at www.armstrongmonitoring.com

The installation of the AMC-UTx-M-xx-0400 Digital Transmitter is very important as the operational quality is a direct result of the quality of the installation. The following sections provide guidelines for installation, location and mounting, wiring, and cable selection.

3.2 Transmitter Mounting

Mount the AMC-UTx-M-xx-0400 Digital Transmitter on a solid, non-vibrating surface or structure. Mount in an area where the ambient concentration of gas is not directly affected by the presence of a clean air supply, ventilation systems, or blockage by surrounding articles. Locate away from sources of interference gases. If the main objective is the fastest possible leak detection, mount the sensor near the potential leak sources. Please refer to local codes for installation information. The installer is required to provide any mounting hardware that may be required.

In order to mount the AMC-UTx-M-xx-0400:

1. Remove cover.
2. Mount housing using defined mounting holes. See the **Enclosure Mounting** figure and **Enclosure Pole Mounting** figure.
3. Drill holes for conduit and then install conduit. See WARNING below.
4. Re-attach cover and bracket.



WARNING:

The transmitter should not be placed near cleaning products/solvents, particularly ones that contain alcohol. This can permanently damage sensor elements or cause negative output values.

Conduit should enter the housing from the bottom to ensure best protection against ingress of condensation.

Conduit entry from the top or back of the housing is Not Recommended. Any water damage related to conduit entry from the top or back will not be covered under warranty.


Qualified personnel should perform the installation according to all applicable electrical codes, regulations and safety standards. Ensure correct cabling practices are implemented.

Mount all equipment away from any source of electro-magnetic interference (EMI) or radio frequency interference (RFI) such as power transformers, electric motors, etc.

Equipment must be positioned such that the change of water damage is minimized; Example away from fire suppression sprinkler heads, away from wet or damp locations where there would be risk of water damage.

Ensure a balanced layout of sensors to cover the intended area. Refer to the **Accessory Mounting** section. If the transmitter is to be mounted on a pole, in a location where water spraying or splashing could be an issue, or in locations where a vandal guard is required.

NOTE: Mount enclosure as shown in the below **Enclosure Mounting** figure. This will ensure correct orientation.

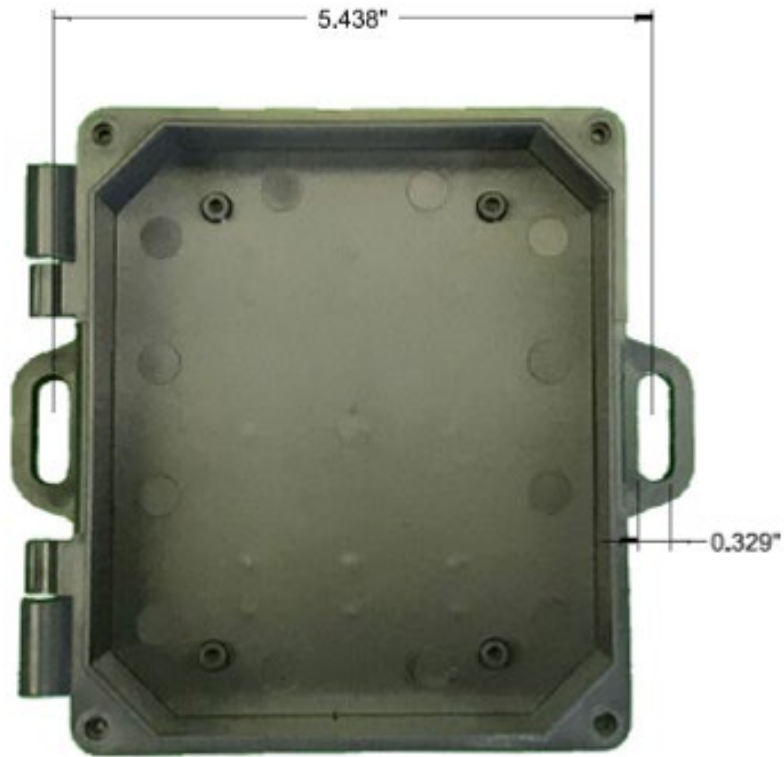

3.3 Accessory Mounting

3.3.1 Weathershield

NOTE: The Weathershield assembly is compatible with both wall and pole mounting configurations. To install the Weathershield follow these steps:

1. Place the Bracket Assembly behind the Transmitter.



2. Mount the Bracket Assembly, and Transmitter to the wall or pole. (Mounting Screws NOT Included).




3. Place the Weathershield over the bracket. The side screws fit into the slots. Tighten the screws to hold the Weathershield in place.



3.3.2 Vandal Guard


NOTE: The Vandal Guard assembly is only compatible with wall mounting configurations. To install the Vandal Guard, follow these steps.

1. Mount the Transmitter to the wall. (Mounting Screws not included).
2. Connect all wiring to the Transmitter.
3. Mount the Vandal Guard to the wall. (Mounting Screws NOT Included). **NOTE:** Mounting hole is 0.25 inch (6.3mm) diameter and are on an 8.0" W x 4.38" H (200mm x 110mm) pattern.

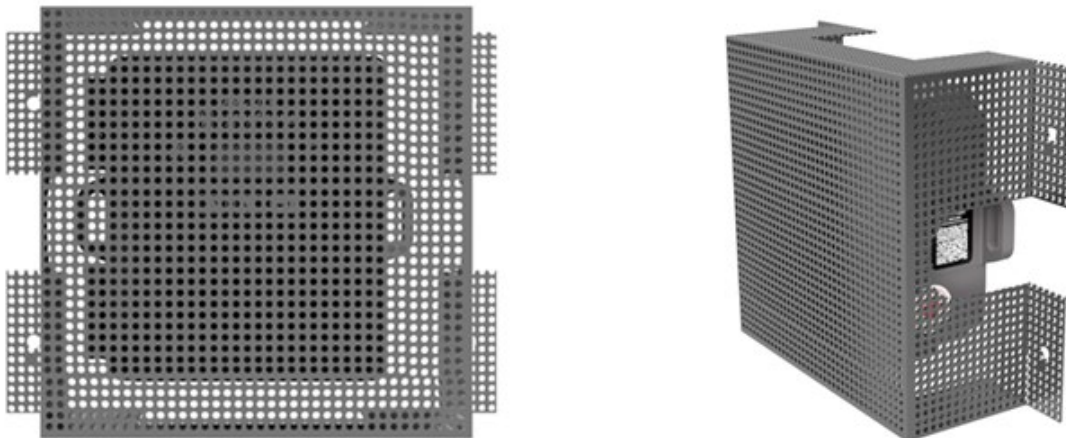



3.3.3 Pole Mounting Brackets

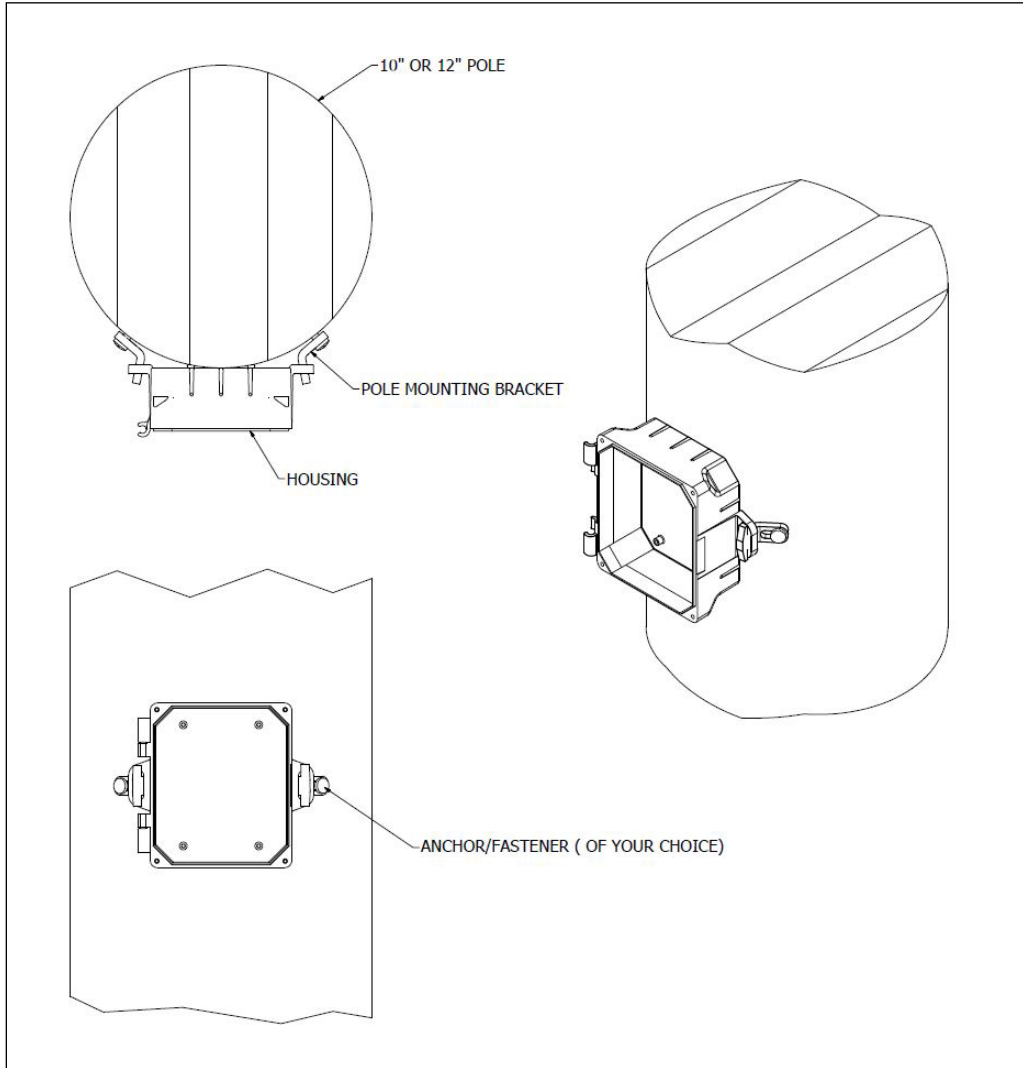



3.4 Wiring

1. The AMC-UTx Digital Transmitter employs a four-wire plus shield system which has two main wiring systems: the monitor communication (two wires) and power supply wiring (two wires).
2. A two conductor, 20-24 AWG shielded cable is recommended to connect the RS-485 signals from the AMC-UTx Digital Transmitter to the monitor. The cable characteristics required are an importance of 120 ohms and a low capacitance 13pf/ft conductor to conductor and 23pf/ft conductor to shield.
3. For best signal transmission and maximum noise rejection, it is recommended to connect the cable shields to chassis ground at the monitor. The shield is wired to the T-connector at each transmitter, to maintain end-to-end continuity.
4. A two conductor 16-24 AWG cable is recommended to connect the power from the Transmitter to the DC power source. The selected cable must meet application and/or local regulatory requirements.
5. Wire gauge will affect maximum distance between transmitters and power supply. Thicker wire is required for greater distance.
6. For wiring taps the derivations must be short (never more than 65ft (20m)). If multiple taps are used with n derivations, the sum of all taps must not exceed a maximum of 130ft (40m). See the below **Connection to an AMC-1DB1-3XXXX Digital Monitor** figure for an example of connections to an AMC-1DB1-3XXXX Digital Monitor.
7. Route cabling away from AC power cabling and any source of electro-magnetic interference (EMI) or radio frequency interference (RFI) such as power transformers, electric motors, etc.
8. EMT (Electrical Metal Tube) conduit also adds an added degree of electrical shielding against EMI (Electro-Magnetic Interference) from devices such as RF (i.e. radio) sources.
9. Cabling should enter the sensors and monitors from the bottom to ensure best protection against water damage.
10. Ensure that there are no short or open circuits in the sensor cabling.
11. Verify that the communication cabling is voltage free prior to connecting the cabling to either the AMC-UTx Digital Transmitter or the monitor.
12. All Shield wires must be covered with insulating material to prevent them from shorting with other wires.

The next pages are electrical wiring diagram examples for an application where the monitor supplies both power and communication.

Warning

| |
|---|
| Installing monitor communication without shield will produce unreliable system wide failure. Armstrong Monitoring Corporation will not support this type of installation. |
|---|



3.4.1 Power

The UTx is 24VDC powered and has a minimum UTx-M operating voltage of 12 Volts. The table below indicates the maximum number of usable units for various wire gauges and distances between units to ensure properly operating voltage. Using lower number of units for the gauge and distance will allow UTx-M-400 unit to operate correctly.

Please consult with Armstrong Monitoring for maximum number of usable units for other gauges or greater distances.

| Average Distance Between Units | 75ft (22m) | | 150ft (45m) | | 200ft (61m) | |
|-----------------------------------|------------|-------|-------------|-------|-------------|-------|
| | 16AWG | 18AWG | 16AWG | 18AWG | 16AWG | 18AWG |
| Number of Units | 27 | 21 | 19 | 15 | 16 | 13 |
| Total Current | 1.49A | 1.16A | 1.05A | 0.83A | 0.88A | 0.72A |

Caution:

Care must be taken when installing to ensure that all UTx-M-400 units are connected with the same power supply polarity across the network. Digital Transmitter + should be connect to +24VDC power terminal at monitor and Digital Transmitter - should be connected to SGND power terminal at monitor.

3.4.2 Communication

The total communication cable length for a network segment should not exceed 3280ft (1000m) without the use of repeaters.

There is a 32-unit load (UL) transmitter limit per RS-485 bus segment determined by ANSI/TIA/EIA-485-A-1998 standard. The AMC-1DBx Digital Monitor uses one RS-485-unit load, so only 31 additional RS-485-unit loads can be driven on each MODBUS Network Segment. Note that each device and the repeaters use a UL on each input.

The AMC-1DMB-PS-R Repeater is required to expand beyond this 32 UL limit configuration limit per MODBUS and requires a unit load itself.

Caution:

Care must be taken when installing to ensure that all Digital Transmitters are connected with the same Modbus polarity across the network. Digital Monitor RS-485A should be connected to the UTx-M A1 terminal and Digital Monitor RS-485B should be connected to the B1 terminal.

Note:

When using an AMC-UTx-M-400 with two MODBUS addresses, only one UL will be required by the AMC-1DBx Digital Monitor.

Typically, the drop out voltage will become an issue on long lengths before the maximum of 31 RS-485 unit loads are connected.

3.4.2.1 End of Line (EOL) Setting

EOL termination is required for the last unit of the bus to ensure robust communication. Without this termination reflections of far end signal can add or subtract to the resulting signal waveform and can cause data corruption.

Note if EOL is set to ON the EOL LED will be lit green when the UTx is powered up. The EOL LED is located on the rear of the UTx Lid.

To change EOL settings on the UTx, you must:

- Remove Power
- Open Lid
- Disconnect BusPower Module using a Phillips Screwdriver as shown below.

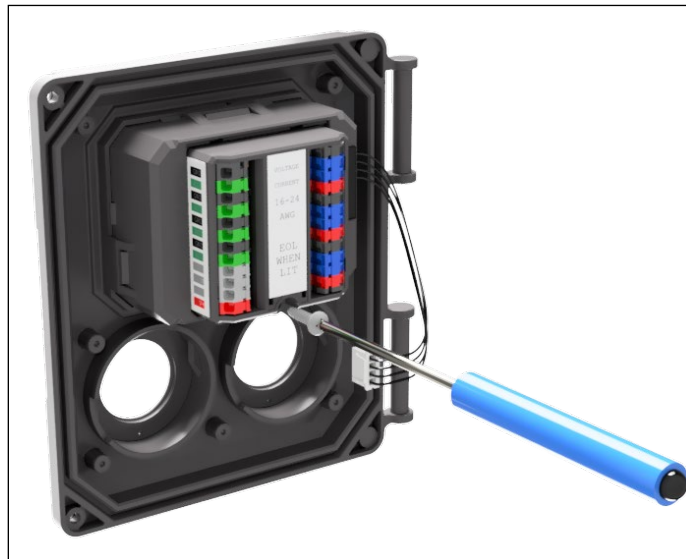


Figure 3-2: Disconnecting BusPower Module

Disconnect BusPower Module from the Lid Assembly as shown below:



Figure 3-3: Removing BusPower Module

Change EOL Setting Switch:



Figure 3-4: EOL Switch

Attach the BusPower Module to the UTx Lid Assembly. Place the top forks in first, then clip the module in place. This can be performed with power on.



Figure 3-5: Replacing BusPower Module

4. Operation

4.1 Overview

This section describes how the functionalities of the Modbus Digital Transmitter are operated and performed. Please consult the Operation and Initial Configuration sections below before attempting to operate the Digital Transmitter.

4.2 Status LEDs

Refer to the **Product Description** section for LED locations and descriptions. During operation the LEDs will display the following configurations:

4.2.1 Start Up

Table 4-1: Status LEDs (Start Up)

| LED States | Network LED | Alarm Status LED | Sensor Module LED | Display Screen Message |
|---|---------------------------------|------------------|-------------------|--|
| Initialization and Discovery of Sensor Modules (after UTx is powered up). | OFF | Solid WHITE | Solid WHITE | AMC Splash Screen |
| Sensor Warm-up | Flashing GREEN (1 sec cycle) | Solid WHITE | Solid WHITE | Main Info Screen (or blank) No Sensor Gas Readings Shown |

4.2.2 Network Status

Table 4-2: Status LEDs (Network Status)

| LED States | Network LED | Alarm Status LED | Sensor Module LED | Display Screen Message |
|--|---------------------------------|------------------|-------------------|------------------------|
| No Network Connection | Flashing GREEN (1 sec cycle) | | | |
| Network Connection Established | Solid GREEN | | | |
| Network Fault (Network Activity Timeout, CRC or Parity Error). | Solid RED | | | |



4.2.3 Faults

Table 4-3: Status LEDs (Faults)

| LED States | Network LED | Alarm Status LED | Sensor Module LED | Display Screen Message |
|---|------------------------------|------------------|--------------------|--|
| Fault 1 | | | | |
| At least one sensor has gone under range (more negative than zero blanking setting). | Flashing GREEN (1 sec cycle) | Solid RED | Solid RED | Gas Bar Indicates "FAULT" For Affected Sensors |
| Fault 2 | | | | |
| Corrupted Sensor Module Signal Sensor Module Missing Incorrect Sensor Module Found Sensor Module NOT Communicating | Flashing GREEN (1 sec cycle) | Solid RED | Solid WHITE or OFF | Gas Bar Indicates "FAIL" For Affected Sensors |



4.2.4 Alarms

Table 4-4: Status LEDs (Alarms)

| LED States | Network LED | Alarm Status LED | Sensor Module LED | Display Screen Message |
|---------------------|---------------------------------|------------------|-------------------|---|
| Threshold 1 Reached | Flashing GREEN (1 sec cycle) | Solid YELLOW | Solid YELLOW | Gas Bar Indicates “WARN” For Affected Sensors |
| Threshold 2 Reached | Flashing GREEN (1 sec cycle) | Solid RED | Solid RED | Gas Bar Indicates “ALARM” For Affected Sensors |
| Threshold 3 Reached | Flashing GREEN (1 sec cycle) | Solid RED | Solid RED | Gas Bar Indicates “ALARM” For Affected Sensors |

4.2.5 Calibration

Table 4-5: Status LEDs (Calibration)

| LED States | Network LED | Alarm Status LED | Sensor Module LED | Display Screen Message |
|---|---------------------------------|------------------|---|------------------------------------|
| Cal Needed | Flashing GREEN (1 sec cycle) | | Flashing CYAN and YELLOW (.5 sec cycle) | Not Indicated on Display Screen |
| In Calibration Mode / Calibration Activity Waiting to Start | Flashing GREEN (1 sec cycle) | | Solid CYAN | Calibration Routine Prompts |
| Calibration Looking for Stable | Flashing GREEN (1 sec cycle) | | Flashing CYAN (.5 sec cycle) | Calibration Routine Prompts |
| Calibration Pass | Flashing GREEN (1 sec cycle) | | Flashing CYAN and GREEN (.5 sec cycle) | Calibration Routine Prompts |
| Calibration Fail | Flashing GREEN (1 sec cycle) | | Flashing CYAN and RED (.5 sec cycle) | Calibration Routine Prompts |

4.2.6 Miscellaneous

Table 4-6: Status LEDs (Miscellaneous)


| LED States | Network LED | Alarm Status LED | Sensor Module LED | Display Screen Message |
|---|------------------------------|--------------------------------|-------------------|---------------------------------|
| Real-Time Clock (RTC) Disabled or Uninitialized | Flashing GREEN (1 sec cycle) | Solid MAGENTA | | Not Indicated on Display Screen |
| Low RTC Battery | Flashing GREEN (1 sec cycle) | Flashing MAGENTA (1 sec cycle) | | Not Indicated on Display Screen |

4.3 Menu Overview

Note that a **Menu Flow Chart** is available further in this manual. The menu images and menu flow diagrams in this manual represent gas types with labels such as “GAS1”, “GAS2”, etc. These are mapped to specific gases based on the customer order.

4.3.1 Normal Operation

Upon startup, a brief splash screen is shown on the display which includes the Armstrong Monitoring Corp’s logo and the current version of the UTx firmware. After a couple of seconds, the display will update to show the main info screen (see below). NOTE: The bar graphs indicating gas concentration are not visible initially while the sensor modules are warming up. The warm-up period will be shown in the details section for the selected sensor until the warm-up period expires. NOTE: Factory configurations define a warm-up default value that prevents false alarms while sensors are warming up. This value may be viewed during warm-up through the detailed sensor screen section.

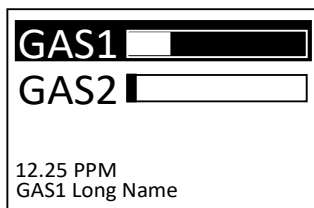


← Highlighted background indicates which sensor is currently selected

← Details pertaining to the selected sensor (its current value and long name)





As shown above, two sensors are currently attached to the transmitter. Only one sensor can be selected at a time for the purpose of inspecting its details. Use the **UP** and **DOWN** buttons to navigate between each sensor. The following diagram illustrates the main info screen after pressing the **DOWN** button from the previous display. Notice how the details are updated to reflect the newly selected sensor.

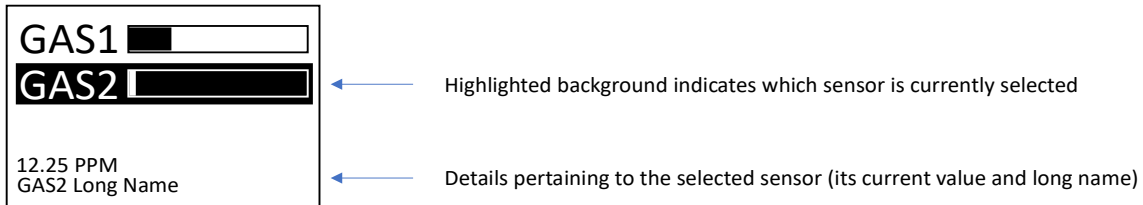

After a programmed timeout period without any button presses, the display will go blank (screen saver mode). To re-enable the display, simply press the **ENTER** button.

4.3.2 Failed Sensor


In the event of a failed sensor, the bar graph is replaced with a large FAIL indication and the detailed description is updated accordingly. If the sensor fails while the display is OFF, the display will immediately turn ON and the failed sensor will be selected by default. In addition, the FAIL indication will toggle between normal and inverse 'white space' mode at a rate of once per second as shown below.

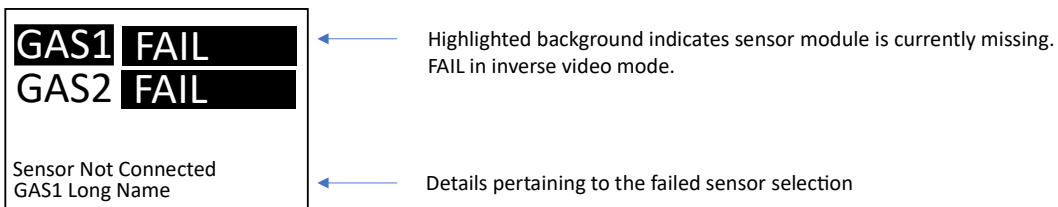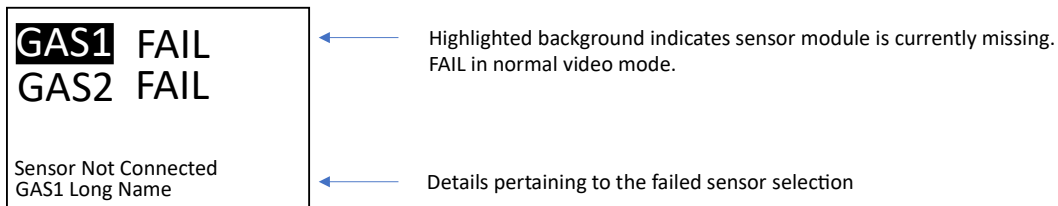

If the failure condition is resolved, the main display for the failed sensor will resume normal operation by indicating the sensor reading via bar graph.


4.3.3 Warning/Alarm Indication

When a warning or an alarm occurs, the bar graph is replaced with a large WARN indication for warnings or a large ALARM for alarms. If the sensor enters a warning or alarm state while the display is OFF, the display will immediately turn ON and the sensor responsible for the warning/alarm will be selected by default. Like the FAIL indication, the WARN/ALARM indication will toggle between normal and inverse 'white space' mode at a rate of once per second as shown below.

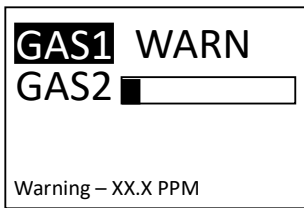


Highlighted background indicates which sensor is currently in a warning state. WARN in normal video mode.

Details pertaining to the sensor

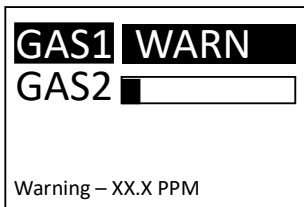


Highlighted background indicates which sensor is currently in a warning state. WARN in inverse video mode.

Details pertaining to the sensor

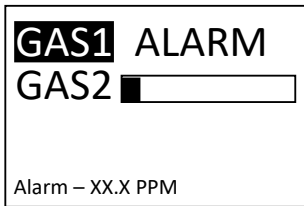

Highlighted background indicates which sensor is currently in alarm. ALARM in normal video mode.

Details pertaining to the selected sensor which is currently in alarm. The current sensor reading is shown.

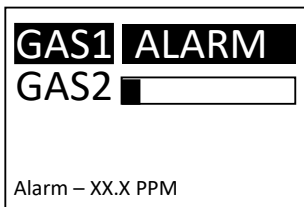

Highlighted background indicates which sensor is currently in alarm. ALARM in inverse video mode.

Details pertaining to the selected sensor which is currently in alarm. The current sensor reading is shown.



For units configured at factory to use latched alarms, when the alarm condition is cleared the display will indicate that the relays are latched until cleared by the user by pressing the **ENTER** button to release the latching condition.



Highlighted background indicates which sensor is currently selected with latched relays. LATCH in normal video mode.

Details pertaining to the selected sensor which currently has its relays in Latched mode. The current sensor reading is shown with an instruction to press the **ENTER** button to release the relays from their active state.




Highlighted background indicates which sensor is currently selected with latched relays. LATCH in inverse video mode.

Details pertaining to the selected sensor which currently has its relays in Latched mode. The current sensor reading is shown with an instruction to press the **ENTER** button to release the relays from their active state.


4.3.4 Fault Indication

The following two menu images show a fault condition in normal and inverse video modes.

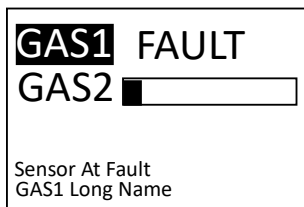

Highlighted background indicates which sensor is currently at fault. FAULT in normal video mode.

Details pertaining to the sensor at fault

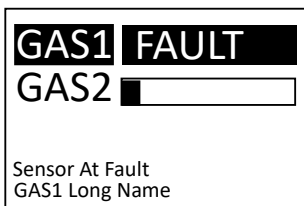

Highlighted background indicates which sensor is currently at fault. FAULT in inverse video mode.

Details pertaining to the sensor at fault



4.3.5 Detailed Sensor Screen

To access the detailed information for each sensor, press and hold the **UP** button until the following screen appears.

| | | |
|-------------------|---|--|
| S1 : GAS1 | ← | Label indicates which sensor is currently selected |
| Current : 2.35 | ← | Current instantaneous value for the selected sensor |
| 15 min avg : 1.75 | ← | 15 min average value for the selected sensor |
| 8 hour avg : 2.82 | ← | 8 hour average value for the selected sensor |
| Daily Peak : 3.71 | ← | Daily peak value for the selected sensor |
| Custom : 0.00 | ← | Custom filter value for the selected sensor (if specified, 0 otherwise) |
| Sensor 1 of 2 | ← | Paging info updated as different sensors are selected using UP/DOWN buttons |

The detailed sensor screen provides several values for each sensor. Use the **UP** and **DOWN** buttons to page through all the attached sensors. This detailed screen will timeout after 30 seconds if no button is pressed thereby returning the user back to the main info screen. Alternatively, the user can exit the detailed sensor screen on demand by pressing the **ENTER** button to return back to the main info screen.

4.3.6 Detailed Status Screen

To access the detailed status for each sensor, press and hold the **DOWN** button until the following screen appears.


| | | |
|----------------------|---|--|
| S1 : GAS1 | ← | Label indicates which sensor is currently selected |
| Status : Normal | ← | Current operational status for the selected sensor |
| Last Cal : 76 days | ← | Number of days since last calibration for the selected sensor |
| Next Cal : 104 days | ← | Number of days until next calibration for the selected sensor |
| Lifetime : 2126 days | ← | Remaining sensor life for the selected sensor |
| S/N : 1234 | ← | Serial number for the selected sensor |
| Sensor 1 of 2 | ← | Paging info updated as different sensors are selected using UP/DOWN buttons |

The detailed status screen provides the complete status for each sensor. Use the **UP** and **DOWN** buttons to page through all the attached sensors. This detailed screen will timeout after 30 seconds if no button is pressed thereby returning the user back to the main info screen. Alternatively, the user can exit the detailed status screen on demand by pressing the **ENTER** button to return to the main info screen.

NOTE: All information dependent on the real-time clock (RTC) such as 'Last Cal' or 'Next Cal' may be incorrect if the RTC is currently disabled or uninitialized (as indicated by a solid magenta on the Alarm Status LED).




Continuing to press **DOWN** after the sensor pages show the firmware version of up to all four modules that are available on the UTx platform. This list also displays the date and time for convenience.

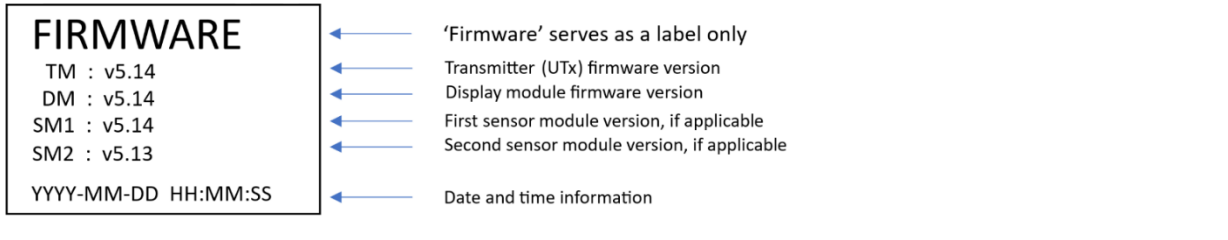


4.3.7 Password Entry

To access the service menu system, the user needs to press and hold the **ENTER** button until the following password entry screen is displayed.

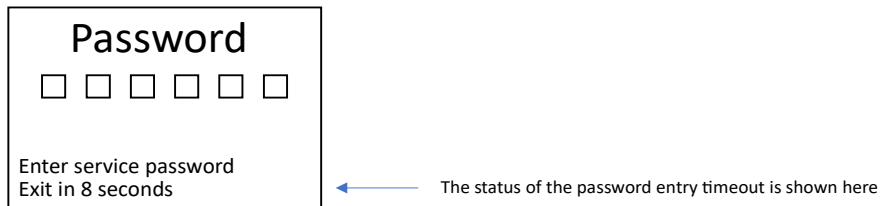

Enter the password using a combination of the **UP**, **DOWN** and **ENTER** buttons. The password is factory set to **UP - DOWN - UP - DOWN - ENTER - ENTER**. As the password is being entered, the display updates with each button press. The diagram below illustrates the state of the password entry after 3 button presses. The password entry screen will timeout after 10 seconds if no button is pressed thereby returning the user back to the main info screen.

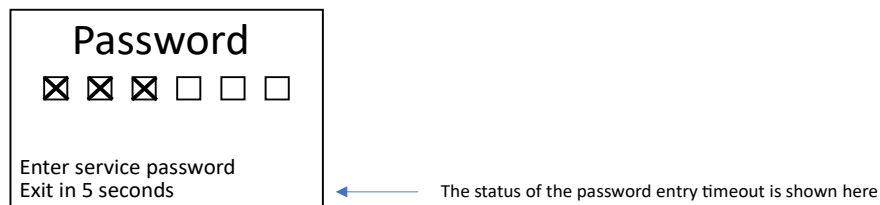


4.3.8 Main Service Menu

4.3.8.1 Service Menu Timeout

The service menus remain unlocked for a programmed timeout period (set to 5 minutes). Within that period, the service menus can be re-enabled by long pressing the **ENTER** button. If the timeout period is allowed to expire, the password entry screen will appear prior to accessing the service menus. Also, if the service menu is active when a timeout occurs, the service mode is disabled, and the display will go blank (i.e. power saving mode). Lastly, the service menu timeout is reset with each button press while the service menus are active.

4.3.8.2 Service Menu Overview

Once the correct password is entered, the main service menu is displayed as shown in the following diagram.

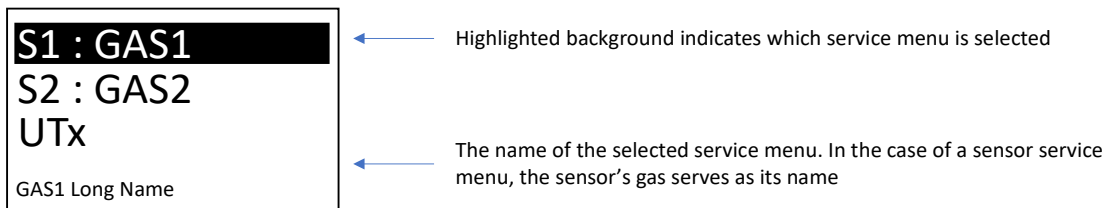


Once again, the **UP** and **DOWN** buttons can be used to navigate the list of service menus. The main service menu provides the menu items listed in the table below:


Table 4-7: Service Menu Options

| Menu Item | Description |
|-------------------------|---|
| <Sensor #>: <Gas Label> | Each sensor is included in the service menu indicated by its number and gas label (Ex: S2: CO). |
| UTx | Access the settings for the transmitter module through the 'UTx' menu item. |
| Exit | Select this menu item to exit the service menu. |

To exit the Service Menu, press **DOWN** repeatedly until the end is reached and Exit is highlighted as shown below.

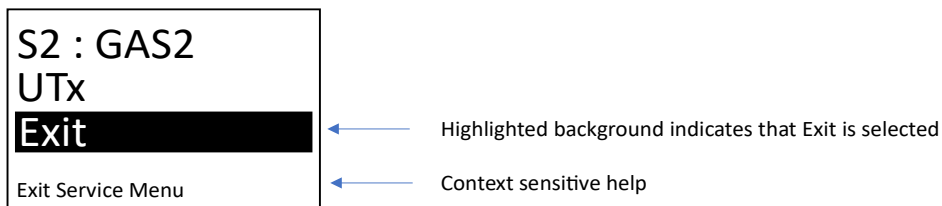


With 'Exit' highlighted (as above), press **ENTER** to exit the service mode and return back to the main info screen as shown below.

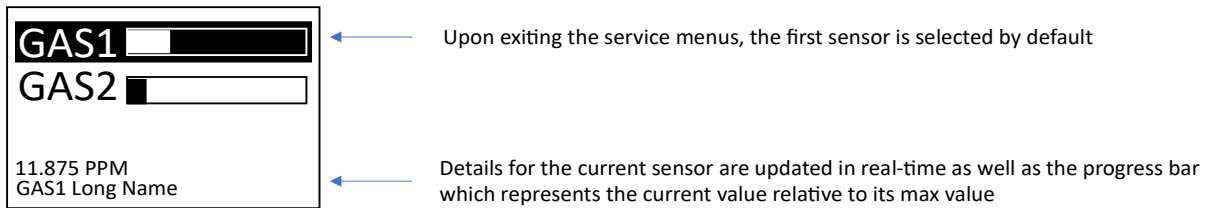

4.3.9 Transmitter Service Menu

If the 'UTx' menu item is activated from the main service menu via the **ENTER** button, then UTx service menu will appear on the display as shown in the following diagram.

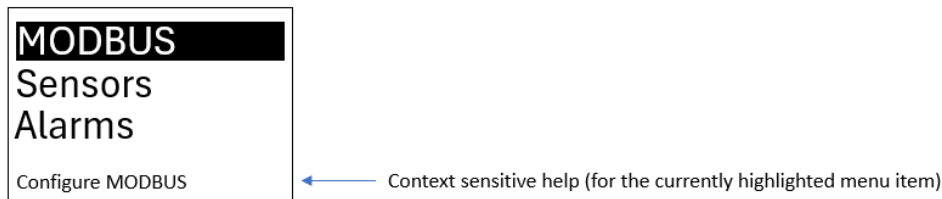


The **UP** and **DOWN** buttons can be used to navigate the list of service menus for the UTx. The following table outlines all the menu items from the UTx menu:

Table 4-8: Transmitter Service Menu Options

| Menu Item | Description |
|-----------|--|
| Modbus | Select this menu item to activate the MODBUS sub-menu. |
| Sensors | Select this menu item to activate the Sensors sub-menu. |
| Alarms | Select this menu item to activate the Alarms sub-menu. |
| Relays | Select this menu item to activate the Relays sub-menu. |
| Test | Select this menu item to toggle the test enable flag. |
| Date | Select this menu item to adjust the Real-Time Clock (RTC) year, month, and day. |
| Time | Select this menu item to adjust the Real-Time Clock (RTC) hour and minute. |
| Reset | Select this menu item to trigger a software reset of the UTx. |
| Exit | Select this menu item to return to the main service menu. The menu item for the UTx will be selected when the main service menu appears. |

4.3.9.1 Modbus Settings

From the UTx service menu, selecting ‘MODBUS’ will update the display to show the following sub-menu:

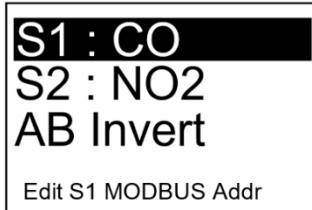


← Context sensitive help (for the currently highlighted menu item)

The **UP** and **DOWN** buttons can be used to navigate the list of menus for the MODBUS sub-menu. The following table outlines all the menu items from the MODBUS sub-menu:

| Menu Item | Description |
|-----------------|---|
| S1: <Gas Label> | Select this menu item to edit the MODBUS address assigned to the Sensor S1. |
| S2: <Gas Label> | Select this menu item to edit the MODBUS address assigned to the Sensor S2. |
| AB Invert | AB Invert is used to swap the Tx/Rx lines through software for future compatibility with different bus power modules employing alternate communication protocols. (e.g. RS-485, RS-422, Ethernet, CAN). |
| Parity | Select this menu item to edit the RS485 parity setting. |
| Exit | Select this menu item to return to the UTx service menu. The MODBUS menu item will be selected when the UTx service menu appears. |

4.3.9.2 Transmitter Sensors Settings

From the UTx service menu, selecting ‘Sensors’ will update the display to show the following sub-menu.

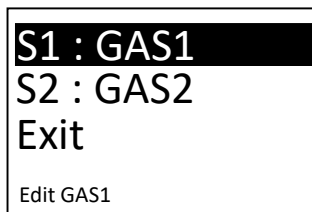

← Context sensitive help (for the currently highlighted menu item)


The **UP** and **DOWN** buttons can be used to navigate the list of configured sensors for the sensors sub-menu. The table below outlines all the menu items from the sensors sub-menu:

Table 4-9: Sensor Module Configuration Menu

| Menu Item | Description |
|-----------|--|
| S1: GAS1 | Select this menu item to activate the configuration sub-menu for sensor 1. |
| S2: GAS2 | Select this menu item to activate the configuration sub-menu for sensor 2. |
| Exit | Select this menu item to return to the UTx service menu. |

4.3.9.3 Sensor Alarm Configuration Sub-Menu

Selecting a sensor from the ‘Sensors’ sub-menu (ex: S1: GAS1) will update the display to show the following sub-menu.

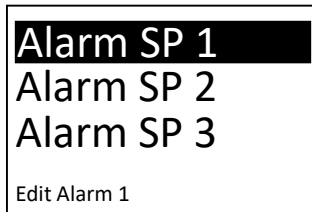

← Context sensitive help (for the currently highlighted menu item)

The **UP** and **DOWN** buttons can be used to navigate the list of menus for the ‘Sensors’ sub-menu. The below table outlines all the menu items from the sensor sub-menu:

Table 4-10: Sensor Alarm Configuration

| Menu Item | Description |
|--------------|--|
| Alarm SP 1-3 | Select this menu item to edit the alarm setpoints for the selected alarm (1-3). |
| Alarm Hyst | Select this menu item to edit the alarm hysteresis. This hysteresis value is applied to all alarm setpoints. |
| Zero Buff | Select this menu item to edit the zero-buffer level for the display of small gas concentrations. |
| Cal Freq | Select this menu item to edit the time period between re-calibrations. |
| Exit | Select this menu item to return to the Sensors sub-menu. |

4.3.9.3.1 Setpoint

If 'Alarm SP 1' is activated from the sensor alarm configuration sub-menu, then the display will be updated to show the following editing screen.

← 'Alarm SP 1' serves as a label only.

← Edit the alarm 1 setpoint value one digit at a time using the **UP/DOWN** buttons. Press **ENTER** to advance the cursor to the next digit. Press **ENTER** when the last digit is highlighted to save the value.

← Context sensitive help

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously).

The same process is repeated for Alarm SP 2 and Alarm SP 3. In all cases, once the confirmation dialog is reached, regardless of which option it selected, the user is returned back to the Sensors sub-menu.

4.3.9.3.2 Alarm Hysteresis

If 'Alarm Hyst' is activated from the sensor sub-menu, then the display will be updated to show the following editing screen.

← 'Alarm Hyst' serves as a label only.

← Edit the alarm hysteresis setpoint value one digit at a time using the **UP/DOWN** buttons. Press **ENTER** to advance the cursor to the next digit. Press **ENTER** when the last digit is highlighted to save the value.

← Context sensitive help

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously). If 'Yes' is selected, the edit value is persisted as the new value for the Alarm Hysteresis for the selected sensor. Otherwise, the edit value is rejected. In either case, the menu returns to the Sensor sub-menu menu with the 'Alarm Hyst' menu item selected.

4.3.9.3.3 Zero Buffer

If 'Zero Buff' is activated from the sensor sub-menu, then the display will be updated to show the following editing screen.

← 'Zero Buff' serves as a label only.


← Edit the alarm hysteresis setpoint value one digit at a time using the **UP/DOWN** buttons. Press **ENTER** to advance the cursor to the next digit. Press **ENTER** when the last digit is highlighted to save the value.

← Context sensitive help

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously). If ‘Yes’ is selected, the edit value is persisted as the new value for the Zero Buffer for the selected sensor. Otherwise, the edit value is rejected. In either case, the menu returns to the Sensor sub-menu menu with the ‘Zero Buff’ menu item selected.

4.3.9.3.4 Calibration Frequency

If ‘Cal Freq’ is activated from the sensor sub-menu, then the display will be updated to show the following editing screen.

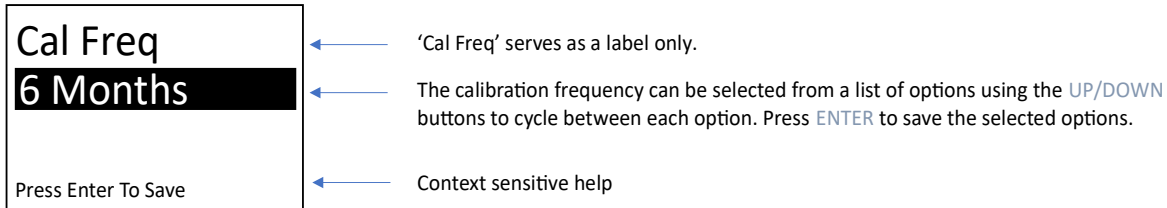

The available options for ‘Cal Freq’ are listed in the table below.


Table 4-11: Calibration Frequency Configuration

| Menu Item | Description |
|-----------|---|
| OFF | Next calibration due date is not calculated. |
| 3 Months | Next calibration due date is calculated as 3 months from last calibration timestamp. |
| 4 Months | Next calibration due date is calculated as 4 months from last calibration timestamp. |
| 6 Months | Next calibration due date is calculated as 6 months from last calibration timestamp. |
| 12 Months | Next calibration due date is calculated as 12 months from last calibration timestamp. |

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously).

4.3.9.4 Transmitter Alarms Settings

From the UTx service menu, selecting ‘Alarms’ will update the display to show the following sub-menu.

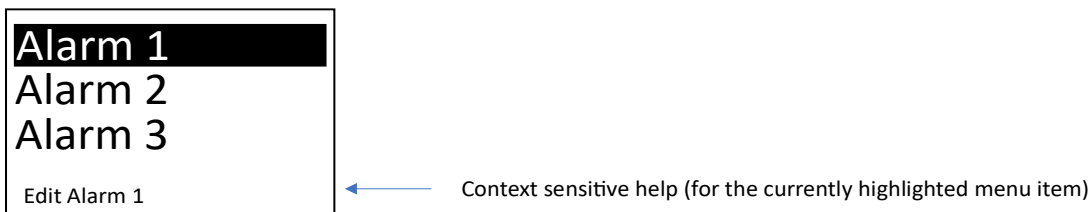


The **UP** and **DOWN** buttons can be used to navigate the list of menus for the Alarms sub-menu. The table below outlines all the menu items from the Alarms sub-menu:

Table 4-12: Transmitter Alarm Settings

| Menu Item | Description |
|------------|---|
| Alarm 1-18 | Select this menu item to activate the configuration sub-menu for the selected alarm. |
| Exit | Select this menu item to return to the UTx service menu. The alarms menu item will be selected when the UTx service menu appears. |

4.3.9.5 Alarm Sub-Menu

Selecting an alarm from the alarms sub-menu will update the display to show the following:

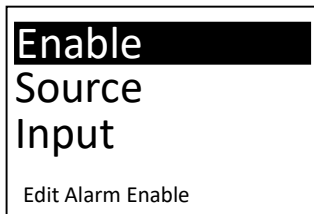

← Context sensitive help (for the currently highlighted menu item)


The below table outlines all the menu items from the alarm sub-menu:

Table 4-13: Transmitter Alarm Sub-Menu Settings

| Menu Item | Description |
|-----------|--|
| Enable | Select this menu item to edit the alarm enable state. |
| Source | Select this menu item to edit the alarm source (i.e. from the available sensors). |
| Input | Select this menu item to edit the alarm input value. |
| Level | Select this menu item to edit the alarm setpoint. |
| Type | Select this menu item to edit the alarm type (increasing or decreasing). |
| Output | Select this menu item to edit the alarm trigger output (i.e. activate which relays). |
| Act Delay | Select this menu item to edit the alarm act delay in terms of seconds. |
| Min Run | Select this menu item to edit the alarm minimum run time in terms of seconds. |
| Exit | Select this menu item to return to the alarm sub-menu. |

4.3.9.5.1 Enable


If 'Enable' is activated from the alarm sub-menu, then the display will be updated to show the following editing screen.

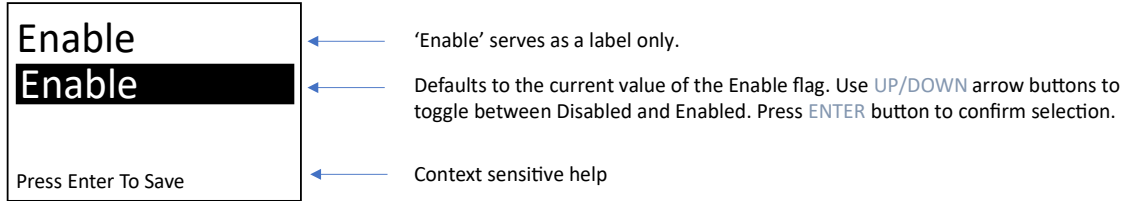

When the **ENTER** button is pressed, the confirmation screen (described previously) is displayed.

4.3.9.5.2 Source

If 'Source' is activated from the alarm sub-menu, then the display will be updated to show the following editing screen.

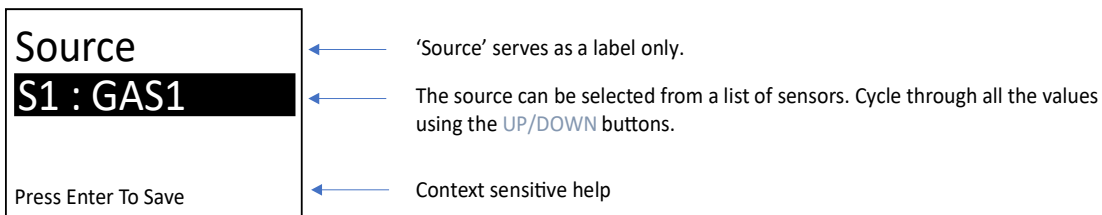


The available options for 'Source' is equal to the list of sensors currently configured for the UTx. The label for each sensor is dynamically assigned to S<n> : GAS<n> where n represents the sensor's 1 base index and GAS represents the sensor's gas name in short form.

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously).

4.3.9.5.3 Input

If 'Input' is activated from the alarm sub-menu, then the display will be updated to show the following editing screen.

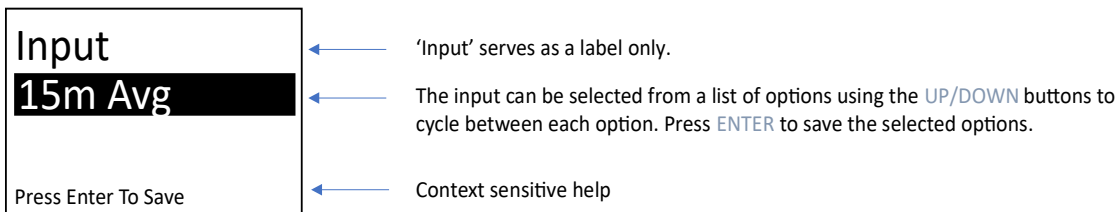

The available options for ‘Input’ are listed in the below table:

Table 4-14: Alarm Input Options

| Menu Item | Description |
|-------------|---|
| Inst. Value | Instantaneous gas value, updated once per second. |
| 15m Avg | Gas concentration averaged over the past 15 minutes. |
| 8h Avg | Gas concentration averaged over the past 8 hours. |
| Custom | Gas concentration averaged over a custom filter window (15-minute multipliers of 2-60. Refer to the above External Sensor Custom Window Average section. |
| Daily Peak | Daily peak value. |

4.3.9.5.4 Level

If ‘Level’ is activated from the alarm sub-menu, then the display will be updated to show the following editing screen.



- ← ‘Level’ serves as a label only.
- ← The level can be selected from a list of options using the UP/DOWN buttons to cycle between each option. Press ENTER to save the selected options.
- ← Context sensitive help

The available options for ‘Level’ are listed in the below table:


Table 4-15: Alarm Setpoint Options

| Menu Item | Description |
|------------|--|
| Alarm SP 1 | Alarm setpoint 1 from the selected source. |
| Alarm SP 2 | Alarm setpoint 2 from the selected source. |
| Alarm SP 3 | Alarm setpoint 3 from the selected source. |

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously).

4.3.9.5.5 Type

If ‘Type’ is activated from the alarm sub-menu, then the display will be updated to show the following editing screen.

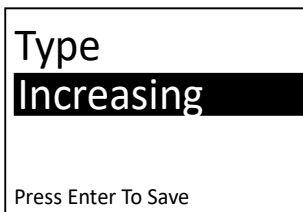

- ← ‘Type’ serves as a label only.
- ← The type can be selected from a list of options using the UP/DOWN buttons to cycle between each option. Press ENTER to save the selected options.
- ← Context sensitive help

The available options for ‘Type’ are listed in the below table:


Table 4-16: Alarm Type Options

| Menu Item | Description |
|------------|---|
| Increasing | Alarm is triggered when alarm exceeds its threshold in an increasing direction. |
| Decreasing | Alarm is triggered when alarm exceeds its threshold in a decreasing direction. |

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously).

4.3.9.5.6 Output

If ‘Trigger’ is activated from the alarm sub-menu, then the display will be updated to show the following editing screen.

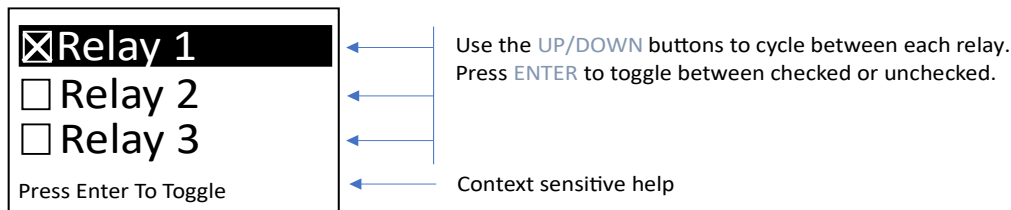


The available options for ‘Output’ are ‘Relay 1’ through ‘Relay 5’. If the checkbox next to the relay is checked, then that relay will activate when the associated alarm is active. Otherwise, the relay will not activate.

NOTE: Relays 3 through 5 are unavailable in the AMC-1B Series. Any attempt to toggle the state of a checkbox associated with an unavailable relay will be ignored. Additionally, only Relay 1 is available on the AMC-UTx-M-400.

When the **ENTER** button is pressed with ‘Done’ selected, the screen will update to Transmitter Alarm Sub-Menu.

4.3.9.5.7 Act Delay

If ‘Act Delay’ is activated from the Alarm sub-menu, then the display will be updated to show the following editing screen.

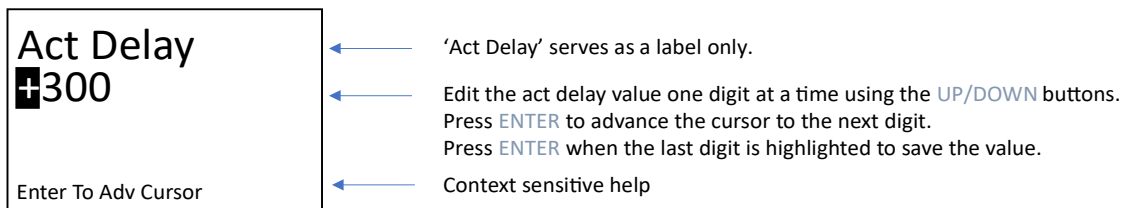

When the **ENTER** button is pressed while the last digit is highlighted, the screen will update to display the confirmation dialog (described previously).

4.3.9.5.8 Min Run

If ‘Min Run’ is activated from the Alarm sub-menu, then the display will be updated to show the following editing screen.

← Edit the minimum run time value one digit at a time using the **UP/DOWN** buttons. Press **ENTER** to advance the cursor to the next digit. Press **ENTER** when the last digit is highlighted to save the value.

← Context sensitive help

When the **ENTER** button is pressed while the last digit is highlighted, the screen will update to display the confirmation dialog (described previously).

4.3.9.6 Transmitter Relay Settings


From the UTx service menu, selecting ‘Relays’ will update the display to show the following sub-menu.

← Context sensitive help (for the currently highlighted menu item)

The **UP** and **DOWN** buttons can be used to navigate the list of menus for the Relays sub-menu. The following table outlines all the menu items from the Relays sub-menu:

| Menu Item | Description |
|-----------|---|
| Local | Select this menu item to activate the configuration sub-menu for the local relay. |
| Exit | Select this menu item to return to the UTx service menu. The Relays menu item will be selected when the UTx service menu appears. |

Selecting a relay from the Relays sub-menu will update the display to show the following:

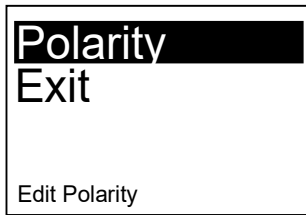


← Context sensitive help (for the currently highlighted menu item)

The following table outlines all the menu items from the relay sub-menu:

| Menu Item | Description |
|-----------|---|
| Polarity | Select this menu item to edit the relay's polarity setting. |
| Exit | Select this menu item to return to the Relays sub-menu. |

If 'Polarity' is activated from the relay sub-menu, then the display will be updated to show the following editing screen.

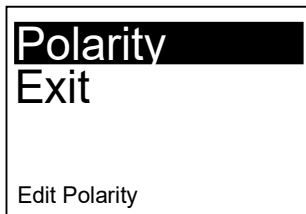

← Context sensitive help (for the currently highlighted menu item)

The available options for 'Polarity' are listed in the following table.


| Menu Item | Description |
|-----------|---|
| Normal | Relay output is energized when associated alarm is active. Otherwise, the relay output is de-energized. |
| Reverse | Relay output is de-energized when associated alarm is active. Otherwise the relay output is energized. |

When the **ENTER** button is pressed, the screen will update to display the confirmation dialog (described previously).


4.3.9.7 RTC Date & Time

The main service menu Date and Time items can be used to update the on-board real-time clock (RTC). The RTC runs on battery power when main power is unavailable. These menus provide a mechanism to update the date and time, for example, in the event of low battery during a power outage.

Use the **UP** and **DOWN** buttons to scroll through available year, month, and day options. A short press of the **ENTER** button will advance to the next digit. A long press of the **ENTER** button will return to the previous digit. Press the **ENTER** button on the last digit to proceed to the confirmation Save dialog.

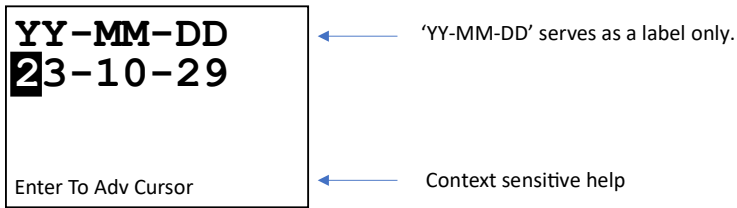

Button presses for Time menu behave in the same manner as the Date menu. Note that it is only possible to update the RTC hour and minute currently.

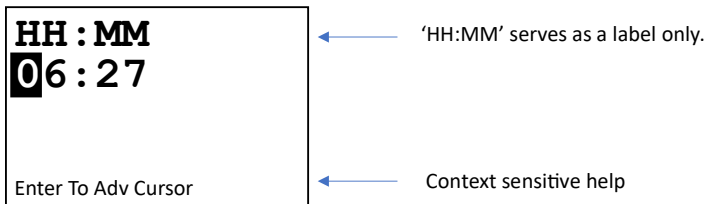

4.3.10 Calibration

Sensors naturally degrade over time, losing about 2% of their sensitivity per month. Over time a sensor will start to underreport gas concentrations, meaning that a calibration is necessary to maintain a safe environment.

When the unit is due for calibration the Sensor Module LED will blink CYAN-YELLOW as opposed to its usual green to be able to see at a glance which sensor(s) is(are) overdue.

Information on Calibration Dates (when calibration is due, calibration frequency) can be found in the UTx Menu.

Caution:

- Only qualified personnel should perform the actual calibration.
- Users new to gas calibration are advised to consult with Armstrong Monitoring.

The Armstrong Monitoring Corporation offers the following calibration plans:

1. Factory pre-calibrated exchange replacement of Sensor Modules.
2. On site installation by Armstrong Monitoring.
3. On site calibration by Armstrong Monitoring.
4. Training by Armstrong Monitoring for end users.

For additional details, please refer to the above **Contact Information** section.



4.3.10.1 Required Equipment; EZ Cal Exchange Program

The following is a recommended list of equipment required:

- Phillips and Robertson screwdriver set.

4.3.10.2 Required Equipment; On-Site Sensor Module Calibration

For qualified personnel, the following is recommended calibration gas for calibration of the AMC-UTx:

| UTx Model No. | Recommended Calibration Gas |
|------------------------------|---------------------------------------|
| AMC-UTx-M-91A01-N-R-0400 | 100ppm CO |
| AMC-UTx-M-98B01-N-R-0400 | 300ppm CO |
| AMC-UTx-M-98A01-N-R-0400 | 6ppm NO ₂ |
| AMC-UTx-M-91A01-98A01-R-0400 | 100ppm CO |
| AMC-UTx-M-VCA01-N-R-0400 | 6ppm NO ₂ |
| AMC-UTx-M-VCB01-N-R-0400 | 300ppm CO 6ppm NO ₂ |
| AMC-UTx-M-60A01-N-R-0400 | 50% LEL CH ₄ |
| AMC-UTx-M-61A01-N-R-0400 | 50% LEL C ₃ H ₈ |
| AMC-UTx-M-62A01-N-R-0400 | 50% LEL H ₂ |
| AMC-UTx-M-70A01-N-R-0400 | Pure Nitrogen |

Note: Calibration gas concentrations above 105ppm CO for 100ppm CO Sensors and 315ppm CO for 300ppm CO Sensors are not supported by the UTx Menu.

For NO₂ Sensors, calibration gas concentrations greater than 10.5ppm are not supported by the UTx menu.

Please refer to the above **UTx Calibration Kit** section for the UTx Calibration Kit that provides the mating adaptor for connecting the calibration gas cylinder to the face of the UTx Sensor Module.

4.3.10.3 Pre Bump Test

Before calibration, a bump test ("as found test") is usually performed to ensure each sensor is in working order and returning reasonable responses. The bump test involves applying a test gas to the sensor. However, sensors such as CO have a recovery time measured in multiple hours. As a result, the calibration routine would find a zero at a concentration that is not the true background concentration, should the sensor not have sufficient recovery time.

The "As Found" menu item (see below **Menu Flow Diagrams** section for **Sensor Service Menu Flow Diagram** figure) allows the user to enter the measured background concentration before performing a bump test. This value is persisted in memory for 24 hours. If a calibration is performed during this 24h period, the persisted background concentration will be used to negate the effect of the bump test and sensor recovery time on the calibration process.



← Context sensitive help (for the currently highlighted menu item)

Before performing a bump test, navigate to the “As Found” menu and enter the current background reading. The user should then navigate to the main screen so that the gas concentration may be monitored during the bump test. The user may then apply a test gas and monitor the response.

4.3.10.4 Calibration Procedure – Menu

Navigate to the UTx Service Menu and select the sensor to be calibrated. If the **ENTER** button is pressed, then the following menu is shown. This menu is common to all sensors therefore selecting any sensor will produce the same menu.

Please refer to the above **Pre Bump Test** section for specific calibration details.



← Context sensitive help (for the currently highlighted menu item)


The **UP** and **DOWN** buttons can be used to navigate the list of service menus for the selected sensor. The sensor’s service menu provides the following menu items:

| Menu Item | Description |
|-----------|---|
| ADAPTiCal | Select this menu item to start calibration for the selected sensor. |
| As Found | Allows user to enter the background concentration reading before performing a bump test. (Refer to the above Bump Test section for further explanation). |
| Window | Allows user to edit the custom window filter for the selected sensor. (Refer to the above Menu System – Sensor Service Menu section). |
| Override | Allows user to override the current sensor value for the selected sensor. (Refer to the below Simulation of Gas Levels section). |
| Reset | Allows user to trigger a software reset of the selected sensor. |
| Exit | Select this menu item to return to the main service menu. The current sensor will be selected when the main service menu appears. |



← Context sensitive help (for the currently highlighted menu item)

With 'ADAPTiCal' highlighted (as above), press **ENTER** to initiate a calibration sequence for the selected sensor. Once initiated, the user will be presented with the following screens in which the background and span level concentrations used for the calibration can be entered:

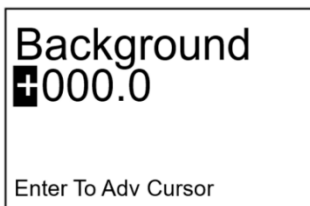


- ← 'Background' serves as a label only.
- ← Edit the current background one digit at a time using the UP/DOWN buttons. Press ENTER to advance the cursor to the next digit. Press ENTER when the last digit is highlighted to save the value.
- ← Context sensitive help



- ← 'Span Level' serves as a label only.
- ← Edit the span level value one digit at a time using the UP/DOWN buttons. Press ENTER to advance the cursor to the next digit. Press ENTER when the last digit is highlighted to save the value.
- ← Context sensitive help

Once the background and span level gas concentrations are entered, the calibration procedure will start automatically, and the state of the calibration will be displayed on the display as shown below. Throughout the entire calibration procedure, the Abort command remains highlighted therefore the procedure can be aborted at any time by pressing the **ENTER** button.

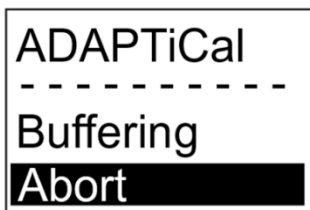


- ← Current state of the calibration procedure
- ← Abort command remains highlighted throughout the entire procedure


During calibration, the procedure will transition through the following set of states:

| Menu Item | Description |
|-----------|--|
| Buffering | A software register is acquiring data before the gas level can be evaluated. |
| Find Zero | The gas concentration for 'zero' gas is determined. |
| Apply Gas | Procedure is ready for the user to apply gas. User will be prompted to be press the ENTER button after the OK command is highlighted in order to indicate when they have applied gas. |
| Find Gas | Calibration routine will stay in this state until it has detected the full application of gas. |
| Find Span | Calibration is underway with the specified gas applied. This state will remain active until it either passes or fails. |

When the calibration procedure completes its cycle, the result will either be a PASSED or FAILED with calibration results as shown by the following two images.

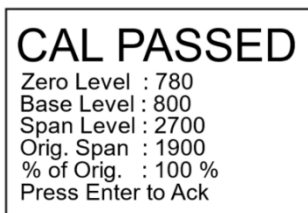

← Pressing the **ENTER** button returns the display to the ADAPTiCal menu item

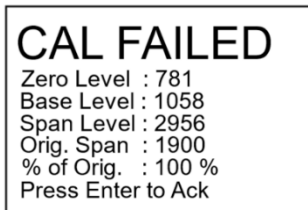

← When a calibration fails for a sensor that was previously calibrated successfully (e.g. factory calibrated), original span is retained.

← Pressing the **ENTER** button returns the display to the ADAPTiCal menu item

In either case, the OK command is highlighted, therefore, press the **ENTER** button to return to the sensor's service menu.

4.3.10.5 Calibration Procedure – Routine

Note: If an “As Found” (Bump Test) is to be performed prior to calibration, first follow the routine outlined in the above **Pre Bump Test** section.

1. To begin calibration, go to the menu, and select the sensor to be calibrate, then select “ADAPTiCal”. Refer to the above **Calibration Menu** section for details.
2. The operator will be asked to provide a background gas concentration. Use the arrow keys to adjust the rightmost digit while pressing enter to commit each digit. Repeat this for all digits.
 - a. It is recommended that prior to calibration to manually set the ventilation system to reduce the background gas concentration to near zero.



- b. It is recommended to use a trusted secondary measurement device (such as a handheld gas meter) to obtain an accurate reading of the background gas concentration. Enter this value for the background gas concentration when prompted.
- c. If background gas concentration cannot be reduced to near zero or if the background gas concentration cannot be established, apply pure nitrogen gas to the sensor prior and during the finding zero stage of calibration. Enter 0 for the background gas concentration when prompted.

CAUTION:

In the case of repeated CO Gas Calibrations performed in quick succession (i.e. less than 30 minutes apart) first follow the routine outlined in the ‘PRE BUMP TEST’ section. Then use the Background value provided by the unit during ADAPTICal startup.

A CO sensor element has a tendency to increase its background zero offset after each span gassing. Entering a Background of 0.0 in the second or third attempt can lead to failed calibration.

3. The operator will then be asked to provide a span level gas concentration (i.e. the concentration of the target gas that is in the cylinder being used to calibrate). Use the arrow keys to adjust the rightmost digit while pressing enter to commit each digit. Repeat this for all digits.
 - a. It is recommended that this concentration be relatively close to the maximum span range of the sensor for best results (as an example, service technicians could use 75ppm gas concentration cylinder for calibrating 100ppm CO Span sensor, however we recommend 100ppm CO).
4. The sensor will enter buffering and the “Find Zero” stage of calibration, assessing the output at the background concentration. When this stage succeeds, the operator will be notified on screen, and the calibration routine will pause until it is acknowledged. Before acknowledging, get the target span gas ready to flow. When **ENTER** is pressed, start applying the gas.
5. The sensor will wait until it detects gas and will enter the “Find Span” stage of calibration. This typically takes between 30 and 180 seconds.
6. Once this stage succeeds, the sensor will check that the result is within limits and notify the operator whether the calibration routine has failed or succeeded. The operator maybe be notified if sensor is nearing end of life.
7. If the calibration fails, the calibration can be attempted again right away, but it is recommended that the operator accepts the background gas concentration provided by the unit since the unit will retain the original background gas concentration.



5. Maintenance

5.1 General

Maintenance is a crucial activity that should be done at the proper time intervals, which are discussed below.

The AMC-UTx-M-xx-400 should be brushed or wiped as required, depending on the rate of accumulation of any dust or dirt.

To avoid sensor damage, the unit **MUST NOT** be submerged in any liquids. Hosing or splashing of the unit with any liquids must also be avoided.

Ensure the green indicators (LEDs) are slowly blinking to indicate a healthy state.

5.2 Scheduled Calibration

Scheduled calibration is critical in maintaining proper function of the AMC-UTx-M-xx-400. It is recommended that the Sensor Module(s) be calibrated a minimum of twice a year or more often for demanding workplace applications. As mentioned, Armstrong Monitoring Corporation offers a number of different maintenance plans to suit your requirements. Please see the above **Contact Information** section for more details.

5.3 Sensor Module

The Sensor Module tracks time since last calibration and will indicate via LED status when service is required. When the Sensor Module can no longer be calibrated, replacement is required; See the **Sensor Module** section for replacement sensor P/N.

5.3.1 Sensor Module Replacement

AMC-UTx-M-xx-400 Sensor Modules are designed to be field replaceable. When changing the sensor module, first ensure that the unit is fully powered down.

5.3.1.1 Remove Sensor Module

Detach the Cable to the top connector on the Sensor Module. Note depending upon Sensor Module position the cable will either connect the Sensor Module to the UTx-Main CCA or to the adjacent Sensor Module.

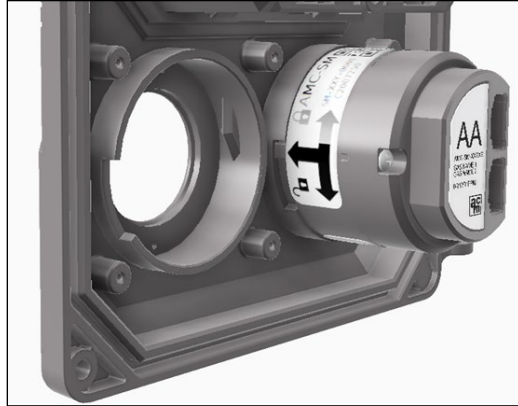


Figure 5-1: Disconnect Sensor Module

Rotate the Sensor Module so the tab aligns as shown and remove from the UTx Lid Assembly.

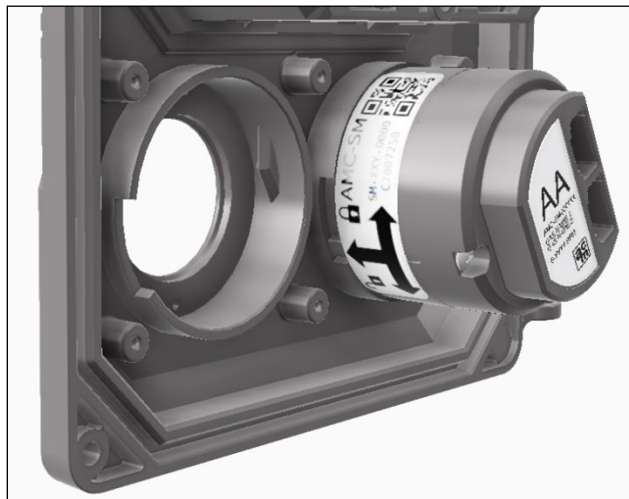


Figure 5-2: Removing Sensor Module from Lid

5.3.1.2 Install Sensor Module

To install the replacement Sensor Module, assemble the Sensor Module to the UTx Lid Assembly.

- Rotate the Sensor Module so the tab aligns as shown.
- Push and turn clockwise until the Sensor module is secured.

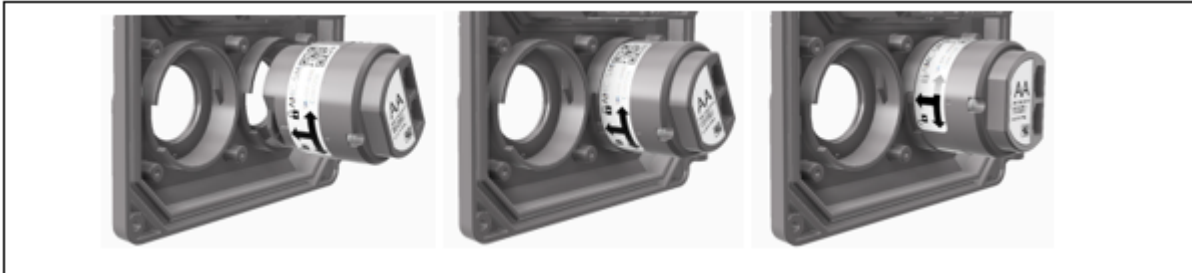


Figure 5-3: Installing Sensor Module

Attach the Cable to the top connector on the Sensor Module. Note: depending upon Sensor Module position the cable will either connect the Sensor Module to the UTx-Main CCA or to the adjacent Sensor Module.



Figure 5-4: Attaching Cable to Sensor Module

5.4 Verification of Operation

Verification of operation should be performed at least once every 6 months. For highly demanding applications more frequent verification is recommended.

5.4.1 Simulation of Gas Levels

The UTx-M Sensor Service Menu allows the current gas reading to be overridden by a simulated gas level. This may be useful during system configuration to verify operation of the Digital Monitor or alarm relays.

If 'Override' is activated from the sensor's service menu, then the display will be updated to show the following sub-menu.

The screenshot shows a menu with the following items: **Sim Enable**, **Sim Gas**, **Exit**, and **Edit Sim Enable**. The **Sim Enable** item is highlighted. Four blue arrows point from the text descriptions to the corresponding menu items:

- ← Activate this menu item to edit the simulated gas enable flag for the selected sensor
- ← Activate this menu item to edit the simulated gas concentration for the selected sensor
- ← Activate this menu item to exit the 'Override' sub-menu
- ← Context sensitive help (for the currently highlighted menu item)

If 'Sim Enable' is activated from the 'Override' sub-menu, then the display will be updated to show the following editing screen.

The screenshot shows the editing screen for 'Sim Enable'. The text **Sim Enable** is at the top, and **Disabled** is highlighted in a black bar. Below the bar is the text **Press Enter to Save**. Two blue arrows point from the text descriptions to the screen:

- ← Defaults to the current value of the Sim Enable flag. Use UP/DOWN arrow buttons to toggle between Disabled and Enabled. Press ENTER button to confirm selection.
- ← Context sensitive help

When the **ENTER** button is pressed, the confirmation screen (described previously) is displayed. If 'Yes' is selected, the edit value is persisted as the new value for the Sim Enable Flag. Otherwise, the edit value is rejected. In either case, the menu returns to the Override sub-menu menu with the 'Sim Enable' menu item selected.

The screenshot shows the 'Override' sub-menu with the following items: **Sim Enable**, **Sim Gas**, **Exit**, and **Edit Sim Gas Enabled**. The **Sim Gas** item is highlighted. Four blue arrows point from the text descriptions to the corresponding menu items:

- ← Activate this menu item to edit the simulated gas enable flag for the selected sensor
- ← Activate this menu item to edit the simulated gas concentration for the selected sensor
- ← Activate this menu item to exit the 'Override' sub-menu
- ← Context sensitive help (for the currently highlighted menu item)

If 'Sim Gas' is activated from the 'Override' sub-menu, then the display will be updated to show the following editing screen.

The screenshot shows a menu with the following text: 'Sim Gas', '100.0', and 'Enter to Adv Cursor'. The '100.0' has a small cursor icon on the first digit. Three blue arrows point from the text on the right to the 'Sim Gas' label, the '100.0' value, and the 'Enter to Adv Cursor' instruction.

- 'Sim Gas' serves as a label only, therefore, this item can not be selected.
- Edit the simulated gas value one digit at a time using the UP/DOWN buttons. Press ENTER to advance the cursor to the next digit. Press ENTER when the last digit is highlighted to save the value.
- Context sensitive help

When the **ENTER** button is pressed with the last digit highlighted, the confirmation screen (described previously) is displayed. If 'Yes' is selected, the edit value is persisted as the new value for the Sim Gas concentration value. Otherwise, the edit value is rejected. In either case, the menu returns to the Override sub-menu menu with the 'Sim Gas' menu item selected.

Selected 'Exit' from the 'Override' sub-menu returns the user to the sensor's service menu with the 'Override' menu item selected.

5.4.2 LED/Relay Activation Test

The UTx-M Service Menu allows the activation of all relays and LEDs, regardless of alarm state. This may be useful during system configuration to verify operation of the LEDs and relays, as well as to verify that the polarity settings are correct.

From the UTx service menu, selecting 'Test' will update the display to show the following:

The screenshot shows a menu with the following text: 'Test', 'Disabled', and 'Press Enter To Save'. The 'Disabled' text is highlighted with a black background. Three blue arrows point from the text on the right to the 'Test' label, the 'Disabled' value, and the 'Press Enter To Save' instruction.

- 'Test' serves as a label only, therefore, this item can not be selected.
- Defaults to the current value of the test enable flag. Use UP/DOWN arrow buttons to toggle between Disabled and Enabled. Press ENTER button to confirm selection.
- Context sensitive help

When the ENTER button is pressed, the confirmation screen (described previously) is displayed.

In addition to activating all relays (taking into account polarity settings), all display and sensor LEDs will appear SOLID WHITE, if functional.



6. Modbus

6.1 Register Set

A developer of a monitor can use the below MODBUS register map to query gas type and gas concentration from an AMC-UTx-M-xx-400 series digital transmitter. A minimalistic monitor need only poll a couple of MODBUS registers to achieve the gas concentration.

- Setup polling MODBUS address with MODBUS protocol at 9600Baud, Even Parity on EIA/TIA-485 link.
- Only Read Holding Register(s) MODBUS function(s) can be used to read these register(s). Up to a maximum number of 12 registers can be read at a time.
- Poll Transmitter Status (Register 2)
 - A hex value not equal to 00xx indicate not available or not ready.
 - A value of 0x008F indicates transmitter is okay at 9600baud with no analog output available.
- Read Gas Number/Device Address (Register 3)
 - A hex Gas Number of 00xx or 01xx or 02xx or 03xx or 09xx represents CO, NO₂, CH₄, Pro(C₃H₈) or H₂ respectively.
- Read Sensor Unit 32-bit Registers r28-r29 currently in PPM or LEL.
 - Swap 16bit values to create 32bit IEEE754 float value in PPM or LEL.

Notes:

*1 Read. These registers can be read or written, write operation is not currently supported and will produce unpredictable results.

*2 Not Supported. The transmitter will provide default or unspecified value.

*3 Float. These registers are a IEEE754 decimal 32 format floating point representation when low and high 16bit registers are swapped (I.e. IEEE 754 Sensor Unit float = r29[31:16] and r28[15:0]). Holding Registers (MODBUS function=03) is supported.



The registers below are based at address 0 and the maximum consecutive registers.

Table 6-1: Modbus Registers 1

| Data Register | Register Index | Monitor Access |
|--|-----------------------|-----------------------|
| Serial Number; a 16-bit number between 1-65535 exclusive to a specific UTx-M model. | 0 | *1 Read |
| Hardware Rev / Software Rev; a 16-bit number made up of four-bit fields: <ul style="list-style-type: none"> - 5-bit hardware version [15:11] (1-32 versions) - 3-bit hardware revision [10:8] (A-H revisions) - 5-bit software version [7:3] (1-32 versions) - 3-bit software revision [2:0] (A-H revisions) These fields are displayed on the LCD during power up. | 1 | *1 Read |
| Transmitter Status / Mode; a 16-bit number made up of two 8-bit fields representing transmitter status and modes. Instrument Status Bits [15:8]: <ul style="list-style-type: none"> - Transmitter Okay = 0x00 - Transmitter Error = 0xFF Instrument Mode Bits [7:0]: (Default 0x8F) <ul style="list-style-type: none"> - Bit 7: Reserved for Self Test = 1 (always being self-tested). - Bit 6: Reserved for Remote Calibration Type = 0 (Remote Calibration Not Supported) - Bit 5: Reserved for Output Enable = 0 (Output Not Available) - Bit 4: Reserved for Output Type = 0 (Output Not Available) - Bit 3: Reserved for Baud Rate = 1 (Fixed at 9600) - Bit 2: Reserved Bit = 1 - Bit 1: Reserved Bit = 1 - Bit 0: Reserved Bit = 1 | 2 | *1 Read |
| Gas Number / Device Address; a 16-bit number made up of two 8-bit fields of Smart Sensor 2 gas number and Transmitter MODBUS address. Gas number is updated from Smart Sensor 2 upon registration. | 3 | *1 Read |

**Table 6-2: Modbus Registers 2**

| Data Register | Register Index | Monitor Address |
|--|-----------------------|------------------------|
| CO = 0 NO ₂ = 1 MODBUS Address [7:0]: 1-247 | | |
| Slope; a reserved 32bit float number representing the slope of the Smart Sensor 2 gas updated from Smart Sensor 2 at registration. Slope is reserved for a monitor-based calibration procedure. *2 Not Supported. | 4-5 | *1 Read *3 Float |
| Offset; a reserved 32bit float number representing the offset of the Smart Sensor 2 gas updated from Smart Sensor 2 at registration. Offset is reserved for a monitor-based calibration procedure. *2 Not Supported. | 6-7 | *1 Read *3 Float |
| Calibration Data1; a reserved 32bit float number for a monitor-based procedure. *2 Not Supported. | 8-9 | *1 Read *3 Float |
| Calibration Data2; a reserved 32bit float number for a monitor-based procedure. *2 Not Supported. | 10-11 | *1 Read *3 Float |
| Calibration Data3; a reserved 32bit float number for a monitor-based procedure. *2 Not Supported. | 12-13 | *1 Read *3 Float |
| Calibration Data4; a reserved 32bit float number for a monitor-based procedure. *2 Not Supported. | 14-15 | *1 Read *3 Float |
| Output Trim Slope; a reserved 32bit float number for calibrating output slope. *2 Not Supported. | 16-17 | *1 Read *3 Float |
| Output Trim Offset; a reserved 32bit float number for calibrating output offset. *2 Not Supported. | 18-19 | *1 Read *3 Float |
| High Alarm; a reserved 32bit float number for Transmitter high alarm set point. *2 Not Supported. | 20-21 | *1 Read *3 Float |
| Low Alarm; a reserved 32bit float number Transmitter low alarm set point. *2 Not Supported. | 22-23 | *1 Read *3 Float |
| Output Span; a reserved 32bit float number for Transmitter output span. *2 Not Supported. | 24-25 | *1 Read *3 Float |
| Output Value; a reserved 32bit float number for Transmitter output value. *2 Not Supported. | 26-27 | *1 Read *3 Float |
| Sensor Unit; a 32bit float number for Smart Sensor 2 Gas Concentration. Currently in PPM or LEL. | 28-29 | *1 Read *3 Float |
| Sensor Output; a 32bit float number for zero based Smart Sensor 2 sensor signal voltage. *Not Supported. | 30-31 | *1 Read *3 Float |



7. Troubleshooting

7.1 Symptoms and Corrective Actions

Table 7-1: Troubleshooting Table

| Symptom | Possible Cause | How to Verify | Corrective Action |
|---|---|--|---|
| UTx-M-400 Gas Reading Does Not Show Up on 1DBX Monitor. | Incorrect Modbus Address specified in either the Monitor or the UTx | Monitor shows UTx-M-400 Gas Sensor Missing. | Enter password, enter UTx service menu and correct MODBUS address for sensor. |
| | Duplicate Modbus Address on two or more UTx-M devices on MODBUS Network | Monitor shows UTx-M-400 Gas Sensor Missing. UTx-M-400 with same MODBUS address show slow-blinking GREEN Network LED (Solid GREEN v5.7+) while other UTx-M-400 units on network detect Network Fault by turning their Network LED RED. | Enter password, enter UTx menu and correct MODBUS address for sensor. |
| | Incorrect Device or gas type specified in the Digital Monitor | Monitor shows gas mismatch by turning off its GREEN System LED. Check monitor's system status in "Get System Info" dialog. | Change monitor's configuration to match Sensor Module gas and MODBUS address settings. Ensure MODBUS addresses are matching for assignment S1 and S2. |
| | Incorrect Parity | UTx-M-400 shows RED on Network LED. | Monitor's MODBUS interface is set to EVEN parity. Check appropriate MODBUS interface configuration in "Set Interface", "RS485 Port" ... Change UTx-M400 parity to match Monitor's EVEN Parity. |



| | | | |
|---|---|--|---|
| | Incorrect Baud Rate Selected | UTx-M-400 shows RED on Network LED. | Monitor's MODBUS interface is set to 9600 Baud. Check appropriate MODBUS interface configuration in "Set Interface", "RS485 Port" ... Change UTx-M400 parity to match Monitor's EVEN Parity. |
| | Incorrect RS485 A/B Connections | UTx-M-400 shows RED on Network LED. | Change wiring or use menu to flip A/B configuration (v5.7-). |
| | Not Connected to MODBUS Network | UTx-M-400 shows blinking GREEN on Network LED. | Check wiring or connect UTx-M400 to MODBUS network. |
| Monitor's RS485 Information has Timeouts or Communication Errors. | End of Line Termination on MODBUS | UTx-M-400 devices flash RED on Network LEDs from time to time. | Ensure last UTx-M400 unit on MODBUS network has EOL switched in on position and EOL LED in lit on that unit. |
| | Multiple End of Line Terminations on MODBUS Network Segment are Installed | UTx-M-400 devices flash RED on Network LEDs from time to time. | Ensure only end UTx-M400 unit on MODBUS segment has EOL switched in the on position and only one EOL LED is lit on Network segment. Ensure Monitor's EOL termination is installed if monitor is at end of network segment. |
| No Gas Concentration on UTx-M-400 Display. | Sensor Module Not Connected or Broken Loose Wire to Sensor Module | No Sensor Module LED. Sensor LED RED. | Check wiring from UTx Module to Sensor Module. |
| Only one Gas Concentration Bar on UTx-M-400 Display. | Second Sensor Module Not Connected or Broken | No Sensor Module LED. Sensor LED RED. | Check wiring from first Sensor Module to |



| | | | |
|--------------------------------------|---|--|---|
| | Loose Wire to Second Sensor Module | | second Sensor Module. |
| | Not a Dual Sensor Module | Sensor LED RED. | Check if Sensor Module has dual sensors or correct type. |
| Local Relay Not Activating. | Configuration Incorrect | No Continuity Between COM and NO Bus Module Terminals. | Check Local Relay is selected in UTx service menu -> Alarms-> Alarm X -> Trigger. |
| Unable to enter ADAPTiCal menu item. | Sensor in warm-up due to power on or recovering post-calibration attempt. | Alarm LED is white. Sensor module in warm-up also has white LED. | Warm-up period will last a maximum of 300 seconds. Display will indicate countdown. ADAPTiCal is not operational/accessible until countdown has finished. |
| | Temperature Sensor Failure. | Alarm LED is green. | Contact Armstrong Monitoring for technical support. |



8. Sensor Module Default Settings

8.1 Default Alarm Settings

Table 8-1: Default Alarm Settings

| SM Code | Short Gas Name | Long Gas Name | Set Point 1 | Set Point 2 | Set Point 3 | Engineering Units |
|---------|-------------------------------|------------------|-------------|-------------|-------------|-------------------|
| | | | Increasing | Increasing | Increasing | |
| 91A | CO | Carbon Monoxide | 25 | 100 | 100 | PPM |
| 98A | NO ₂ | Nitrogen Dioxide | 1 | 3 | 3 | PPM |
| VCA | CO | Carbon Monoxide | 25 | 100 | 100 | PPM |
| | NO ₂ | Nitrogen Dioxide | 1 | 3 | 3 | PPM |
| VCB | CO | Carbon Monoxide | 25 | 100 | 200 | PPM |
| | NO ₂ | Nitrogen Dioxide | 1 | 3 | 3 | PPM |
| 60A | CH ₄ | Methane | 20 | 40 | 80 | % LEL |
| 61A | C ₃ H ₈ | Propane | 20 | 40 | 80 | % LEL |
| 62A | H ₂ | Hydrogen | 20 | 40 | 80 | % LEL |
| | | | Decreasing | Decreasing | Decreasing | |
| 70A | O ₂ | Oxygen | 19.5 | 17 | 17 | % VOL |



8.2 Default Sensor Module Settings

Table 8-2: Default Sensor Module Settings

| SM Code | Short Gas Name | Long Gas Name | Span | Hysteresis | Zero Blanking | Engineering Units |
|---------|-------------------------------|------------------|------|------------|---------------|-------------------|
| 91A | CO | Carbon Monoxide | 100 | 2.50 | +/- 5.0 | PPM |
| 91B | CO | Carbon Monoxide | 300 | 2.50 | +/- 5.0 | PPM |
| 98 | NO ₂ | Nitrogen Dioxide | 10 | 0.25 | +/- 0.5 | PPM |
| VCA | CO | Carbon Monoxide | 100 | 2.50 | +/- 5.0 | PPM |
| | NO ₂ | Nitrogen Dioxide | 10 | 0.25 | +/- 0.5 | PPM |
| VCB | CO | Carbon Monoxide | 300 | 2.50 | +/- 5.0 | PPM |
| | NO ₂ | Nitrogen Dioxide | 10 | 0.25 | +/- 0.5 | PPM |
| 60A | CH ₄ | Methane | 100 | 2.50 | +/- 5.0 | % LEL |
| 61A | C ₃ H ₈ | Propane | 100 | 2.50 | +/- 5.0 | % LEL |
| 62A | H ₂ | Hydrogen | 100 | 2.50 | +/- 5.0 | % LEL |
| 70A | O ₂ | Oxygen | 25 | 0.625 | +/- 1.25 | % VOL |

9. Menu Flow Diagrams

9.1 Main Screen / Password Flow

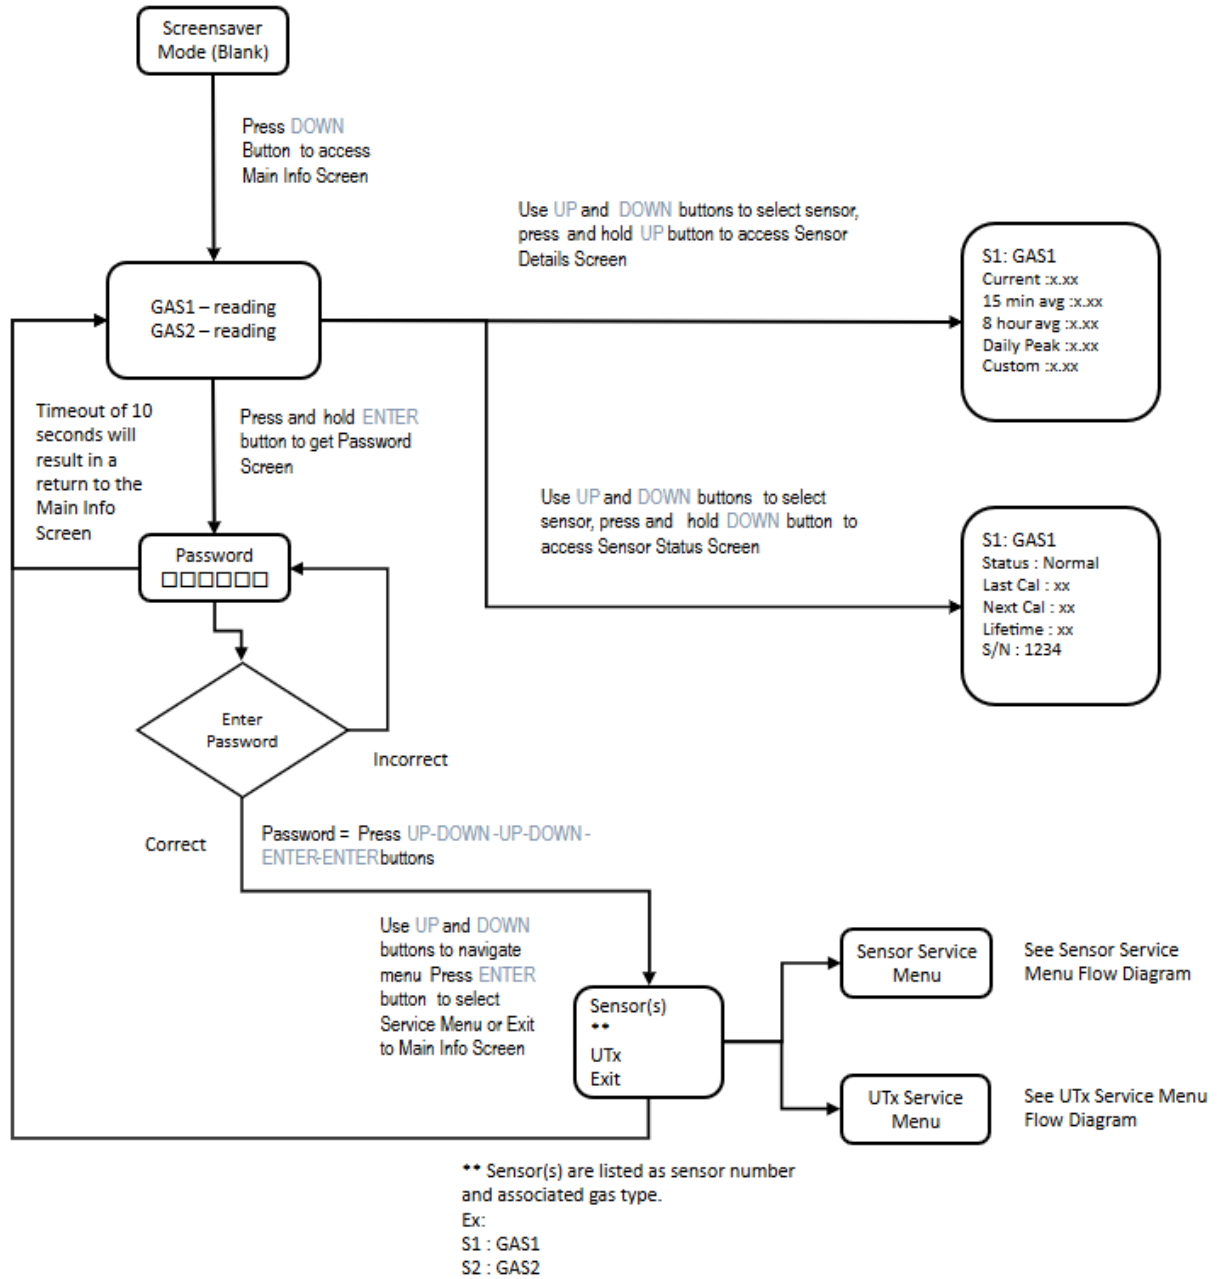


Figure 9-1: Main Screen / Password Flow Diagram

9.2 UTx Service Menu

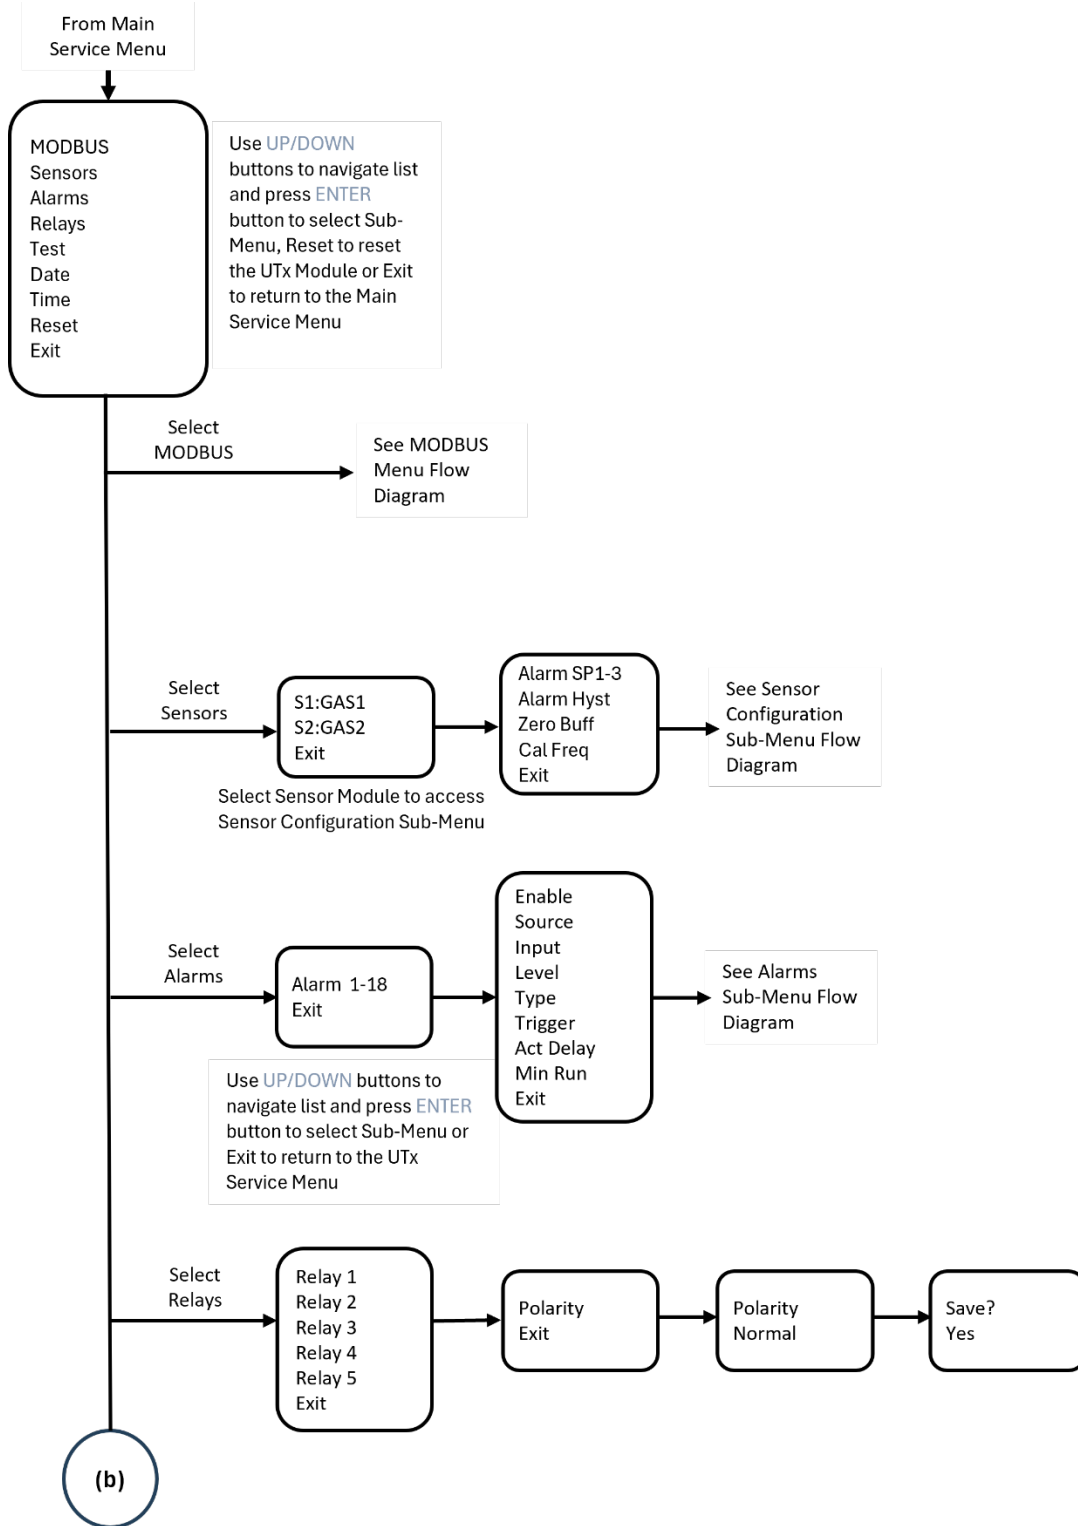


Figure 9-2: UTx Service Menu Flow Diagram (a)

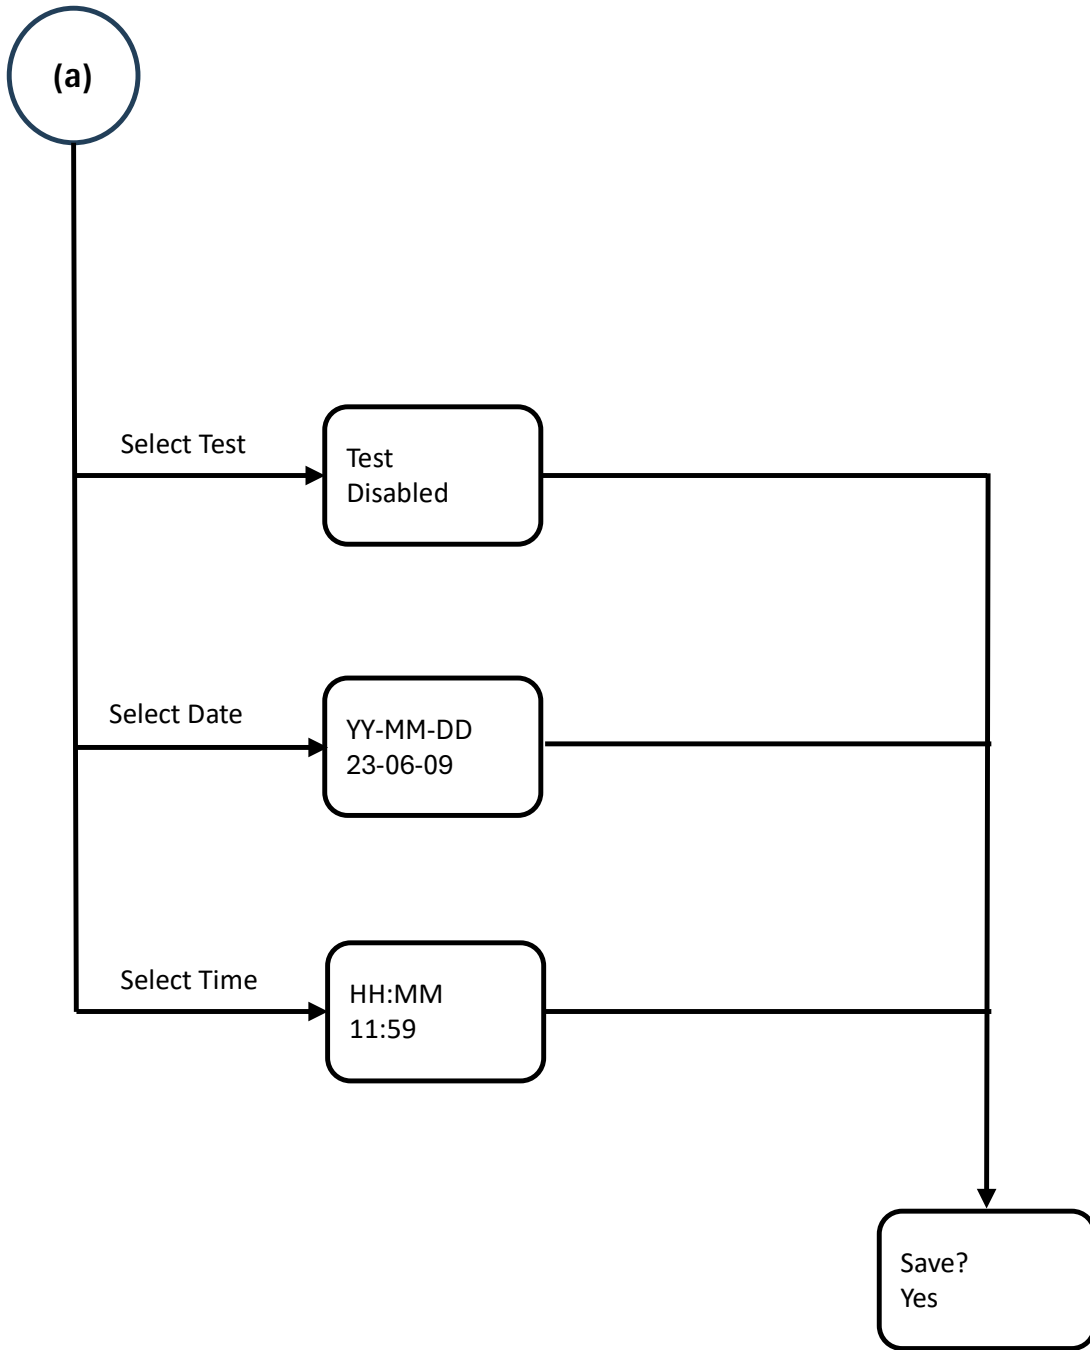


Figure 9-3: UTx Service Menu Flow Diagram (b)

9.3 Modbus Menu

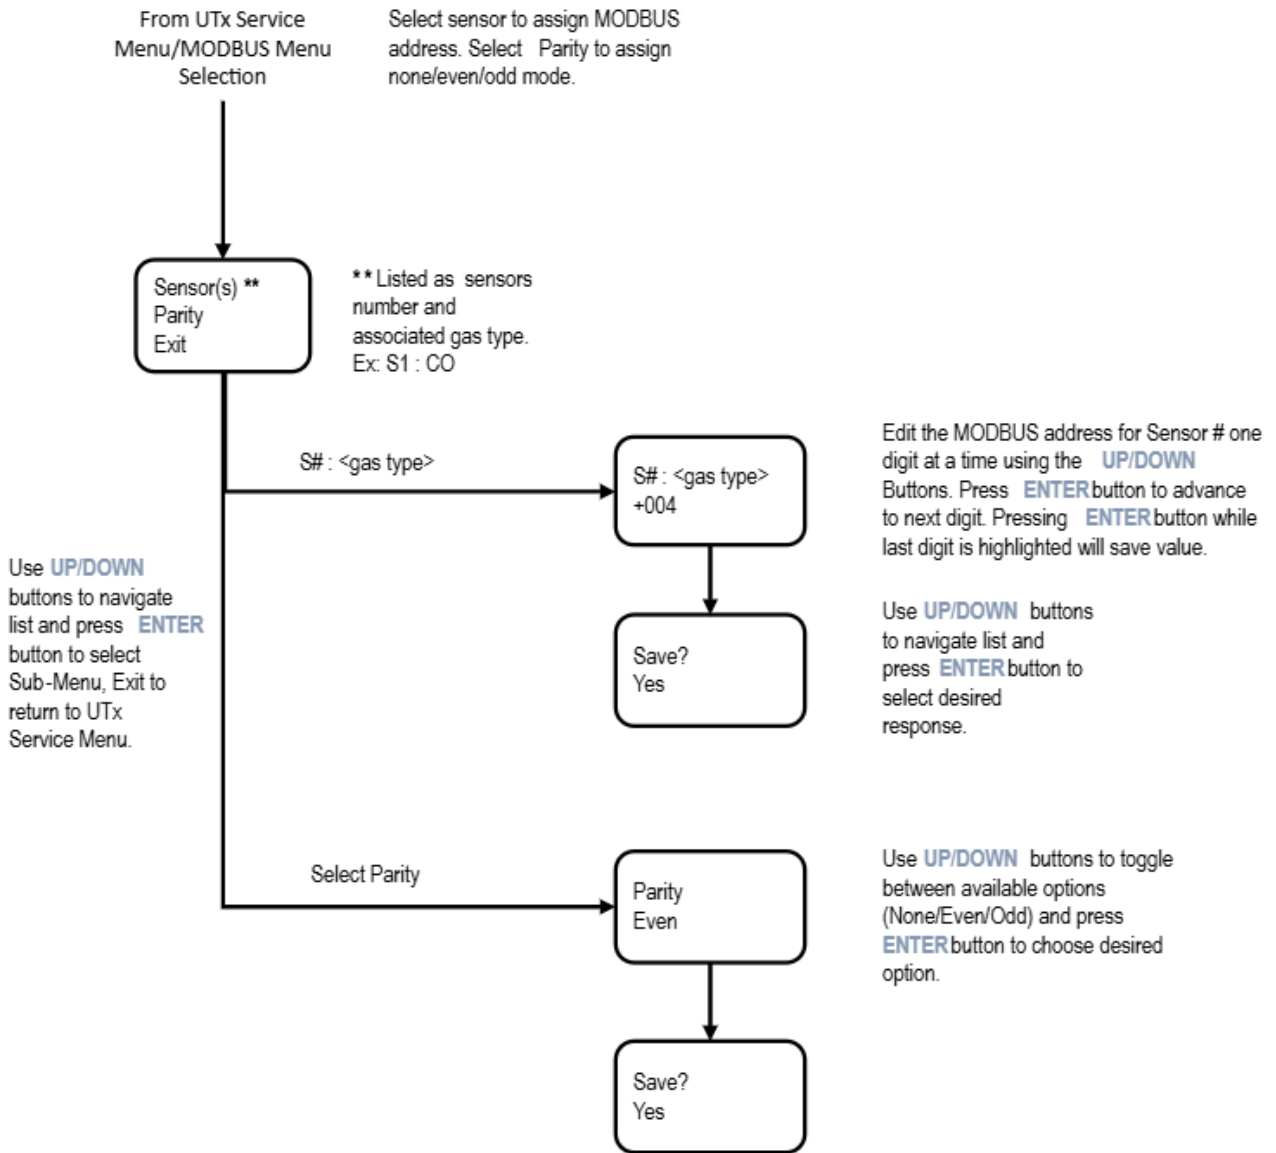


Figure 9-4: Modbus Menu Flow Diagram

9.4 Sensor Service Menu

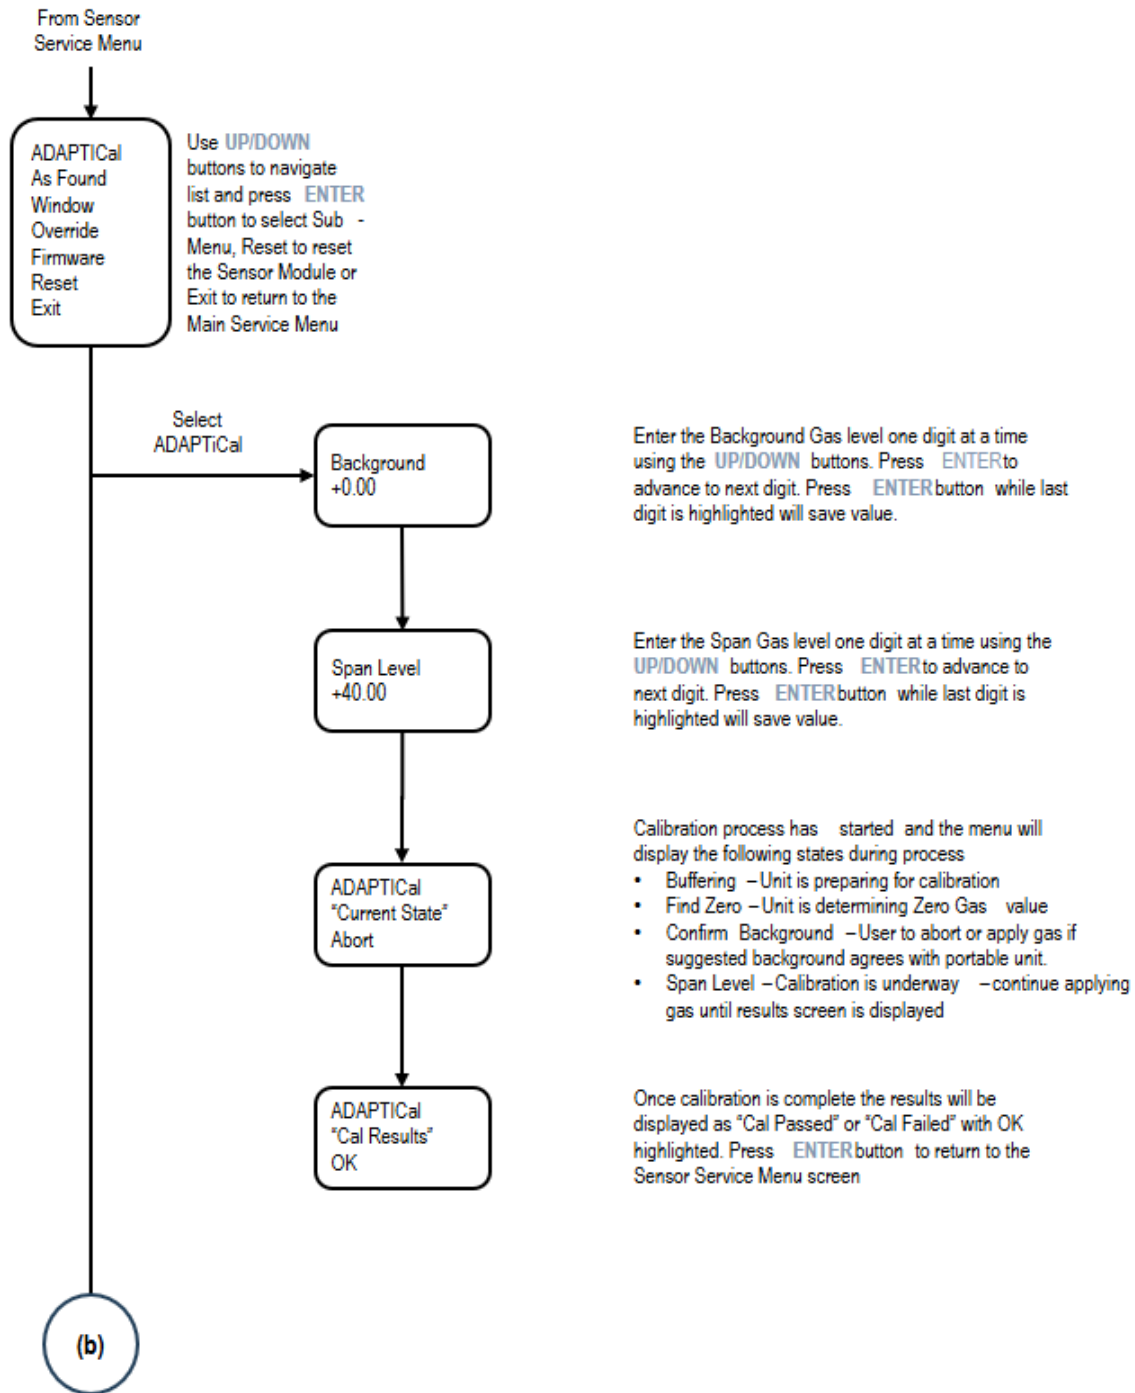


Figure 9-5: Sensor Service Menu Flow Diagram (a)

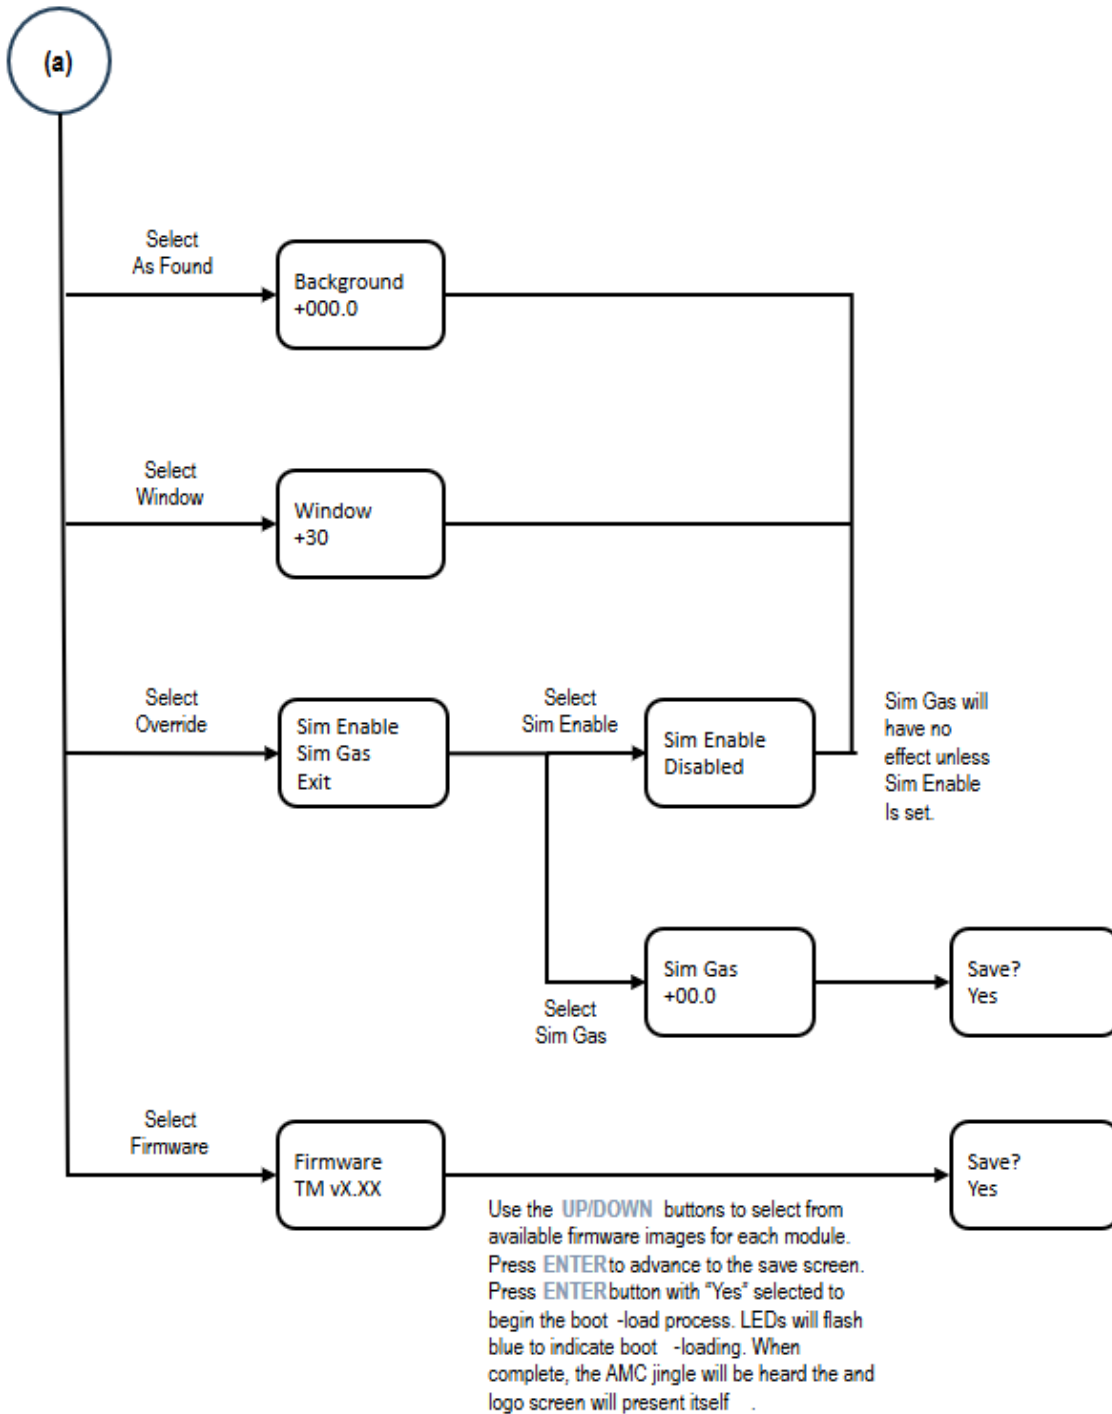


Figure 9-6: Sensor Service Menu Flow Diagram (b)

9.5 Sensor Configuration Menu

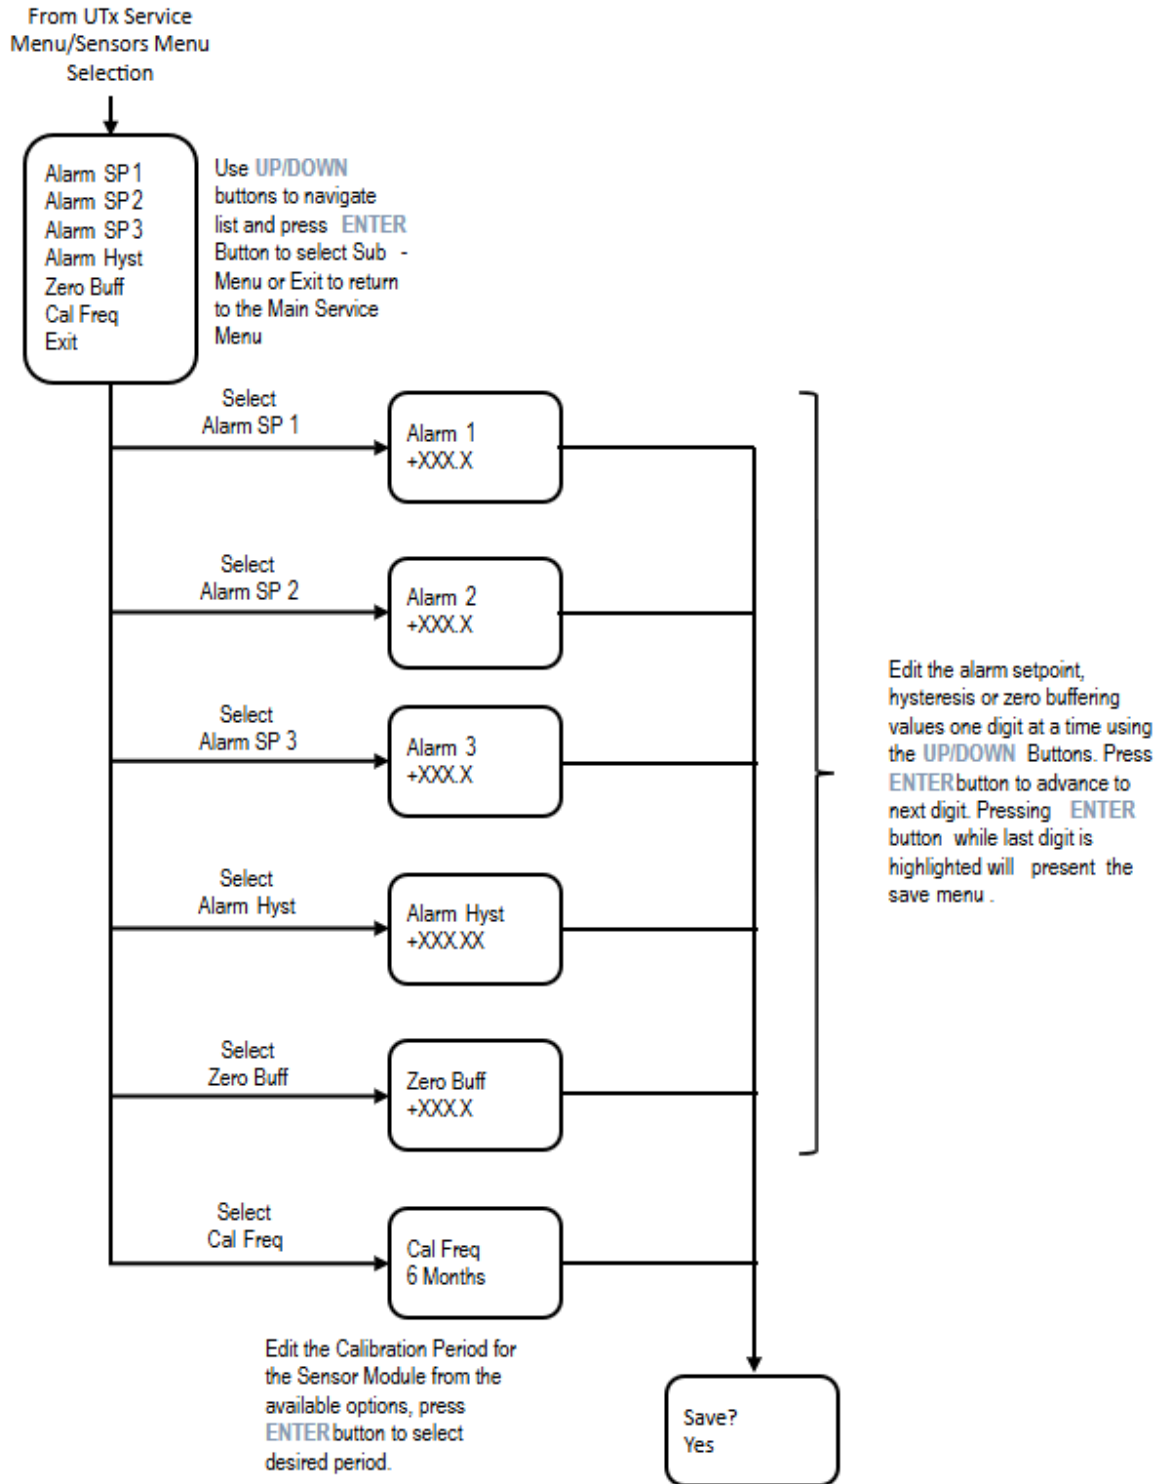


Figure 9-7: Sensor Configuration Menu Flow Diagram

9.6 Alarm Menu

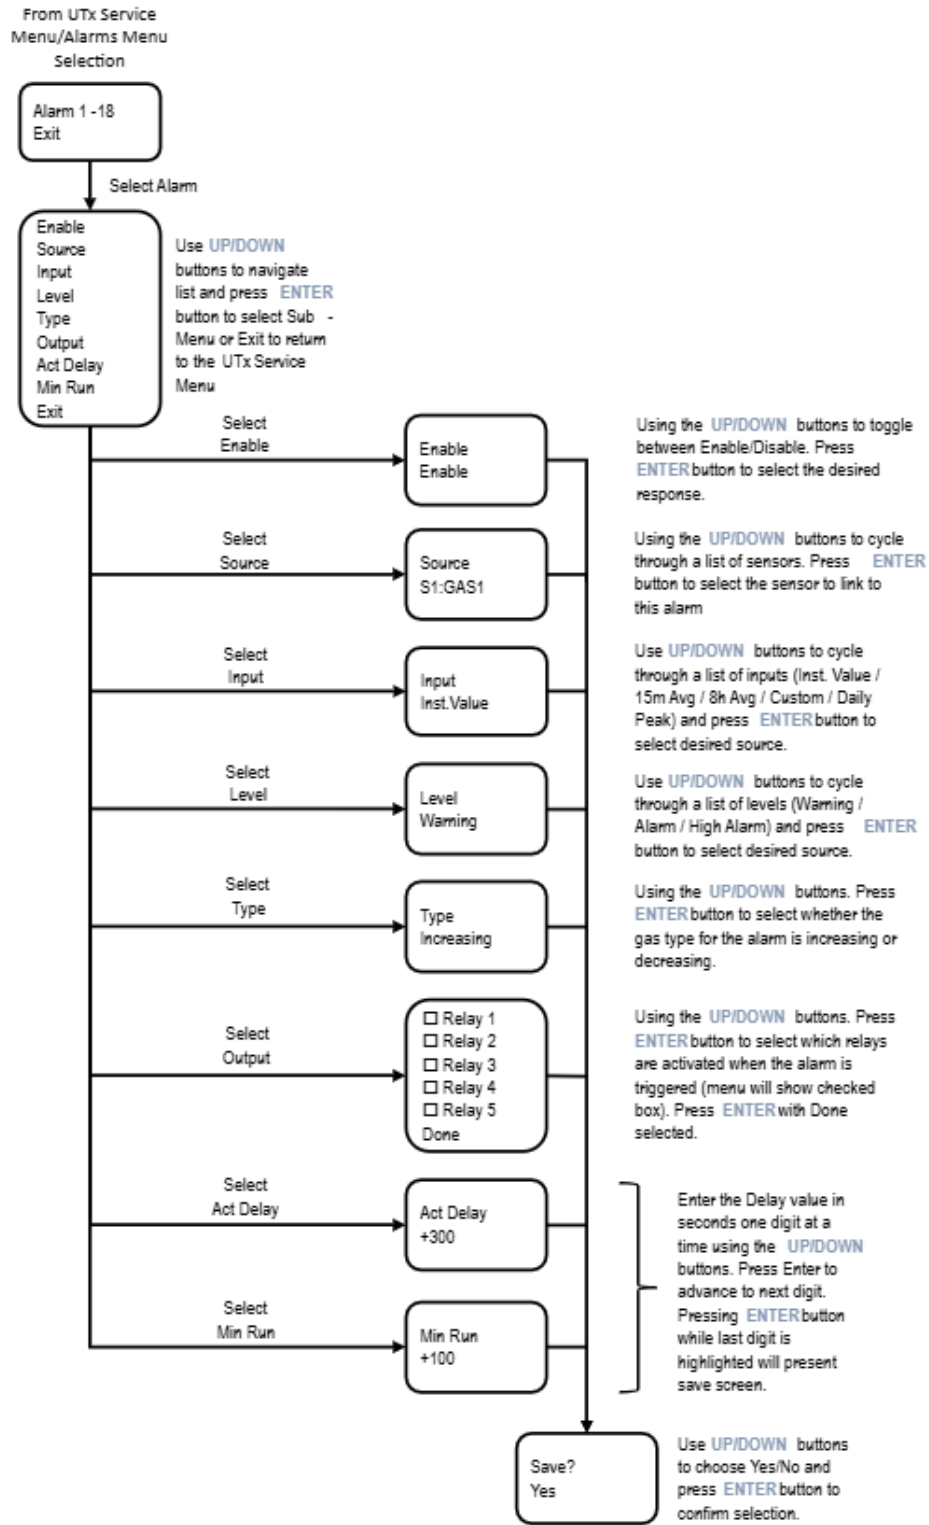


Figure 9-8: Alarm Menu Flow Diagram



10. Revision History

10.1 Document Revision History

| Revision | Release Date | Change Description |
|----------|--------------|---------------------|
| B | July 2025 | Initial Web Release |